



PFAS adsorbability: PFSA>PFCA>PFECA

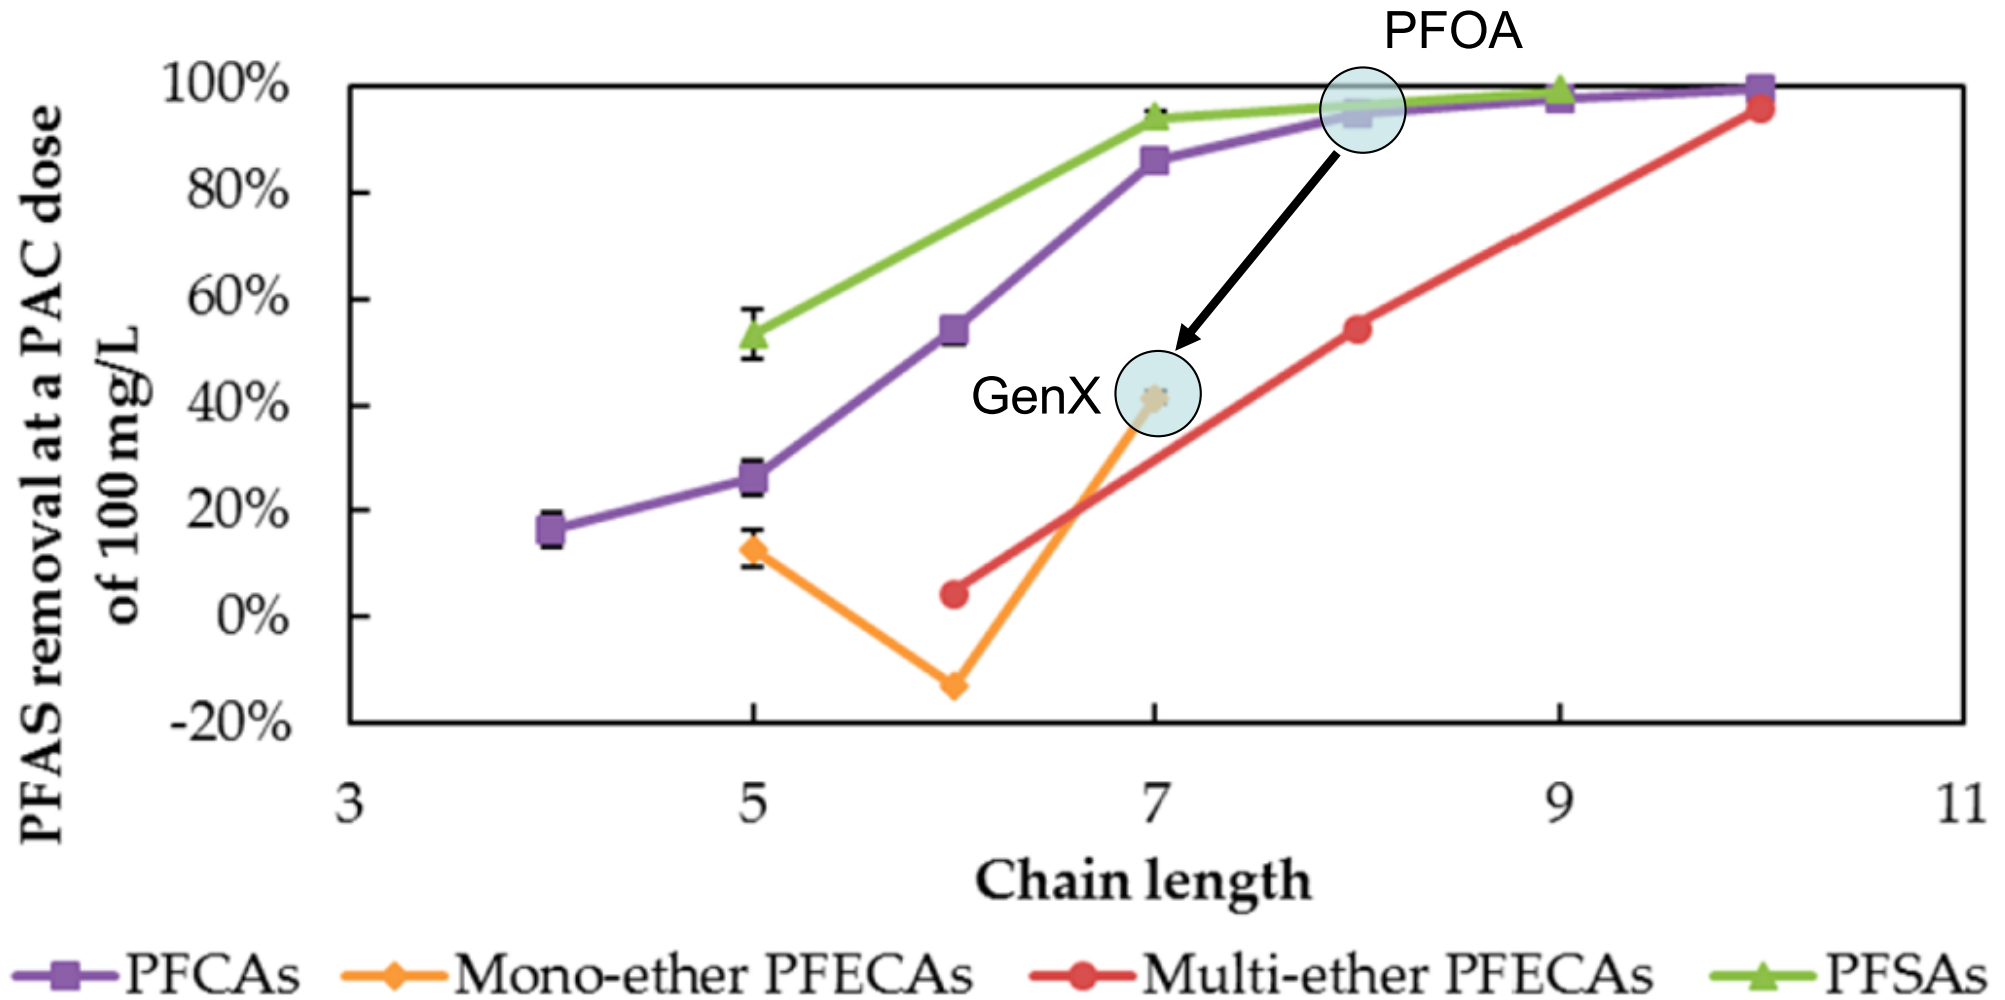

Proposed sampling plan

1,4-Dioxane and PFAS Fate in
Urban Water Cycle

Objective 1: Determine fate of 1,4-dioxane and perfluoroalkyl substances (PFASs) in the urban water cycle

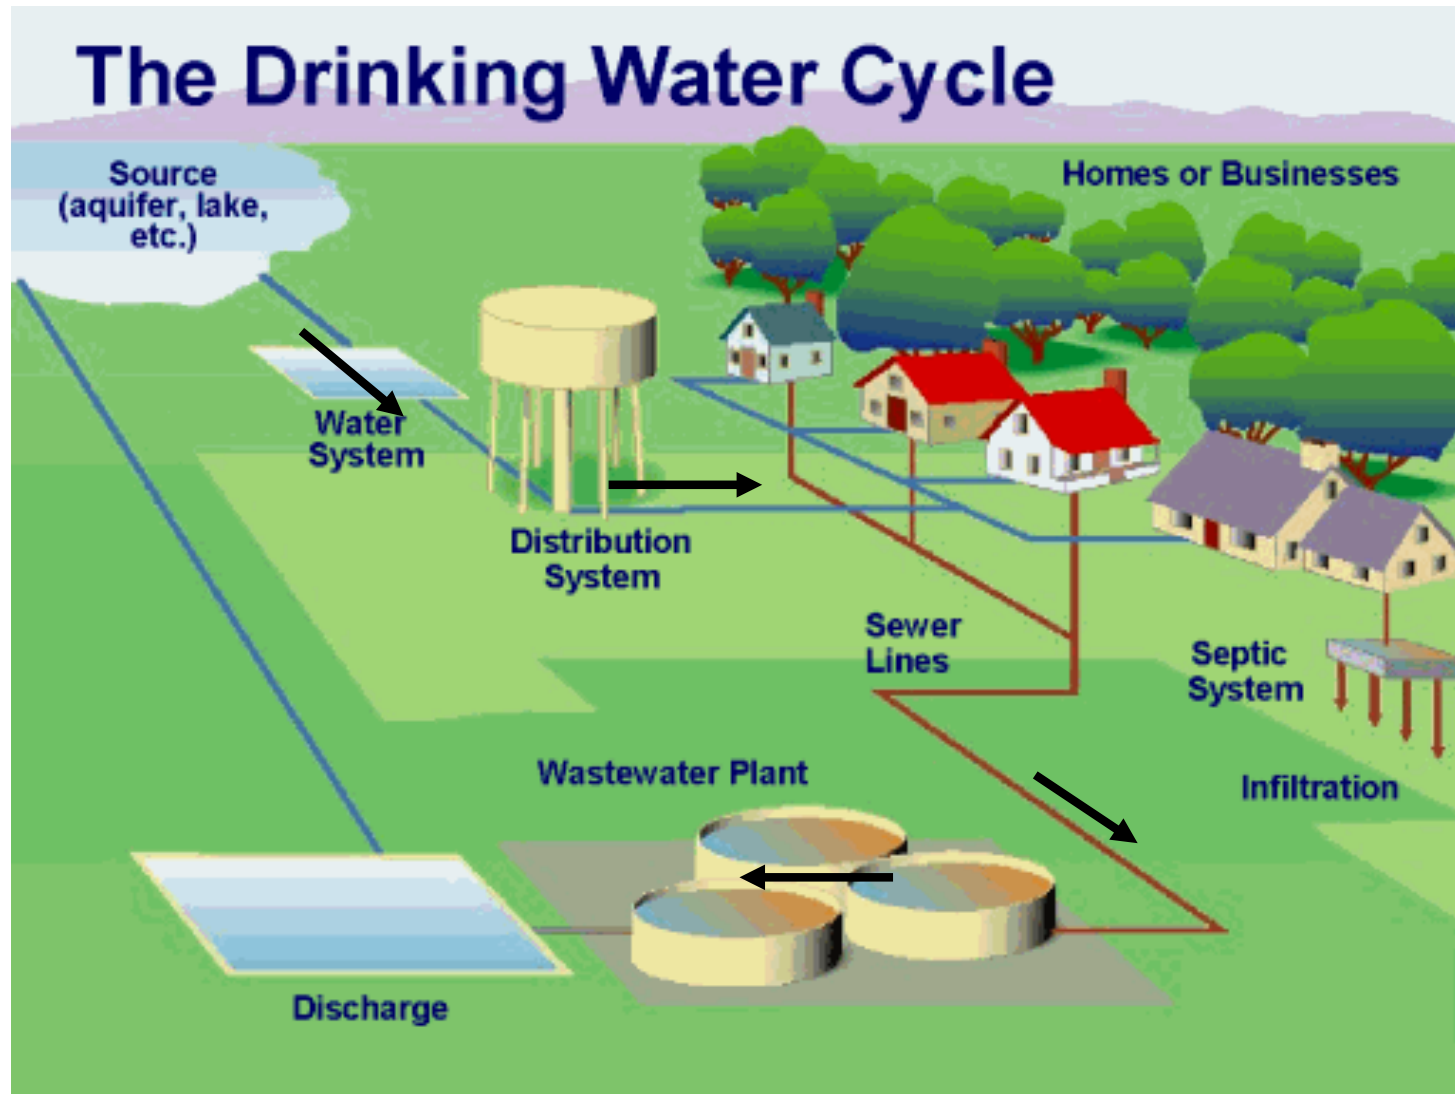

Identify residence times/water ages at suitable sampling points to trace a parcel of water through the water/wastewater system

Objective 2: Determine fate of 1,4-dioxane and PFASs during aquifer storage and recovery (ASR)

Sample monthly for one ASR cycle (ASR and monitoring wells)

- Recharge
- Storage
- Recovery

Laboratory	Biweekly	Monthly
Cape Fear Public Utilities Authority	Temperature, pH, turbidity, specific conductance, dissolved oxygen, redox potential, residual chlorine (during recharge)	Total organic carbon, trihalomethanes
NCSU	Nitrate, nitrite, ammonium, sulfate, chloride, bromide, fluoride	1,4-dioxane, PFASs, dissolved organic carbon, UV ₂₅₄ absorbance

Objective 3: Determine possible association of 1,4-dioxane and PFASs with biosolids

Measure 1,4-dioxane and PFAS concentrations in aqueous and solid phases of biosolids. Determine partition coefficients.

Target Audiences for Results

- CFPUA staff
 - Data expected to illustrate treatment/ operational challenges associated with PFASs and 1,4-dioxane
 - Demonstrate need for source control – eliminate PFASs and 1,4-dioxane at upstream NPDES discharge locations
- North Carolina DEQ
 - Raise awareness about treatment challenges with emerging contaminants
 - Expand scope of current 1,4-dioxane working group to start looking at possibilities for controlling PFAS sources

Acknowledgments

- National Science Foundation (Award #1550222)
- North Carolina Urban Water Consortium
- Adam Pickett, Chris Smith, Michael Richardson, Ben Kearns at participating utilities

Legacy and Emerging Perfluoroalkyl Substances Are Important Drinking Water Contaminants in the Cape Fear River Watershed of North Carolina

Mei Sun,^{*,†,‡,§,||} Elisa Arevalo,[‡] Mark Strynar,[§] Andrew Lindstrom,[§] Michael Richardson,^{||} Ben Kearns,^{||} Adam Pickett,[⊥] Chris Smith,[#] and Detlef R. U. Knappe[‡]

[†]Department of Civil and Environmental Engineering, University of North Carolina at Charlotte, Charlotte, North Carolina 28223, United States

[‡]Department of Civil, Construction, and Environmental Engineering, North Carolina State University, Raleigh, North Carolina 27695, United States

[§]National Exposure Research Laboratory, U.S. Environmental Protection Agency Research, Triangle Park, North Carolina 27711, United States


^{||}Cape Fear Public Utility Authority, Wilmington, North Carolina 28403, United States

[⊥]Town of Pittsboro, Pittsboro, North Carolina 27312, United States

[#]Fayetteville Public Works Commission, Fayetteville, North Carolina 28301, United States

Supporting Information

ABSTRACT: Long-chain per- and polyfluoroalkyl substances (PFASs) are being replaced by short-chain PFASs and fluorinated alternatives. For ten legacy PFASs and seven recently discovered perfluoroalkyl ether carboxylic acids (PFECAs), we report (1) their occurrence in the Cape Fear River (CFR) watershed, (2) their fate in water treatment processes, and (3) their adsorbability on powdered activated carbon (PAC). In the headwater region of the CFR basin, PFECAs were not detected in raw water of a drinking water treatment plant (DWTP), but concentrations of legacy PFASs were high. The U.S. Environmental Protection Agency's lifetime health advisory level (70 ng/L) for perfluorooctanesulfonic acid and perfluorooctanoic acid (PFOA) was exceeded on 57 of 127 sampling days. In raw water of a DWTP downstream of a PFAS manufacturer, the mean concentration of perfluoro-2-propoxypropanoic acid (PFPrOPrA), a replacement for PFOA, was 631 ng/L ($n = 37$). Six other PFECAs were detected, with three exhibiting chromatographic peak areas up to 15 times that of PFPrOPrA. At this DWTP, PFECA removal by coagulation, ozonation, biofiltration, and disinfection was negligible. The adsorbability of PFASs on PAC increased with increasing chain length. Replacing one CF₂ group with an ether oxygen decreased the affinity of PFASs for PAC, while replacing additional CF₂ groups did not lead to further affinity changes.

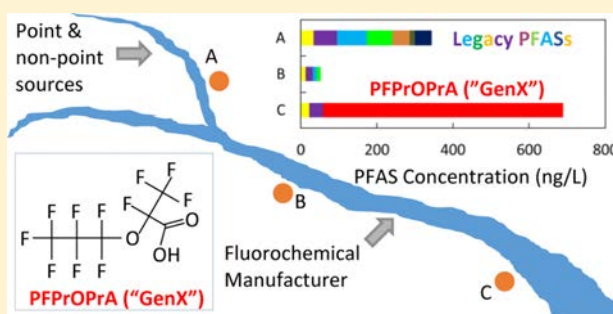

INTRODUCTION

Per- and polyfluoroalkyl substances (PFASs) are extensively used in the production of plastics, water/stain repellents, firefighting foams, and food-contact paper coatings. The widespread occurrence of PFASs in drinking water sources is closely related to the presence of sources such as industrial sites, military fire training areas, civilian airports, and wastewater treatment plants.¹ Until 2000, long-chain perfluoroalkyl sulfonic acids [$C_nF_{2n+1}SO_3H$; $n \geq 6$ (PFASs)] and perfluoroalkyl carboxylic acids [$C_nF_{2n+1}COOH$; $n \geq 7$ (PFECAs)] were predominantly used.² Accumulating evidence about the ecological persistence and human health effects associated with exposure to long-chain PFASs^{3,4} has led to an increased level of regulatory attention. Recently, the U.S. Environmental Protection Agency (USEPA) established a lifetime health

advisory level (HAL) of 70 ng/L for the sum of perfluorooctanoic acid (PFOA) and perfluorooctanesulfonic acid (PFOS) concentrations in drinking water.^{5,6} Over the past decade, production of long-chain PFASs has declined in Europe and North America, and manufacturers are moving toward short-chain PFASs and fluorinated alternatives.^{7–10} Some fluorinated alternatives were recently identified,^{8,11} but others remain unknown^{12–14} because they are either proprietary or manufacturing byproducts.

Received: October 13, 2016

Revised: November 8, 2016

Accepted: November 10, 2016

Published: November 10, 2016

One group of fluorinated alternatives, perfluoroalkyl ether carboxylic acids (PFECAs), was recently discovered in the Cape Fear River (CFR) downstream of a PFAS manufacturing facility.¹¹ Identified PFECAs included perfluoro-2-methoxyacetic acid (PFMOAA), perfluoro-3-methoxypropanoic acid (PFMOPrA), perfluoro-4-methoxybutanoic acid (PFMOBA), perfluoro-2-propoxypropanoic acid (PFPrOPrA), perfluoro-(3,5-dioxahexanoic) acid (PFO2HxA), perfluoro(3,5,7-trioxa-octanoic) acid (PFO3OA), and perfluoro(3,5,7,9-tetraoxadecanoic) acid (PFO4DA) (Table S1 and Figure S1). The ammonium salt of PFPrOPrA is a known PFOA alternative¹⁵ that has been produced since 2010 with the trade name “GenX”. To the best of our knowledge, the only other published PFECA occurrence data are for PFPrOPrA in Europe and China,¹⁵ and no published data about the fate of PFECAs during water treatment are available. Except for a few studies (most by the manufacturer),^{16–20} little is known about the toxicity, pharmacokinetic behavior, or environmental fate and transport of PFECAs.

The strong C–F bond makes PFASs refractory to abiotic and biotic degradation,²¹ and most water treatment processes are ineffective for legacy PFAS removal.^{22–27} Processes capable of removing PFCAs and PFASs include nanofiltration,²⁸ reverse osmosis,²⁵ ion exchange,^{28,29} and activated carbon adsorption,^{28,29} with activated carbon adsorption being the most widely employed treatment option.

The objectives of this research were (1) to identify and quantify the presence of legacy PFASs and emerging PFECAs in drinking water sources, (2) to assess PFAS removal by conventional and advanced processes in a full-scale drinking water treatment plant (DWTP), and (3) to evaluate the adsorbability of PFASs on powdered activated carbon (PAC).

MATERIALS AND METHODS

Water Samples. Source water of three DWTPs treating surface water in the CFR watershed was sampled between June 14 and December 2, 2013 (Figure S2). Samples were collected from the raw water tap at each DWTP daily as either 8 h composites (DWTP A, 127 samples) or 24 h composites (DWTP B, 73 samples; DWTP C, 34 samples). Samples were collected in 250 mL HDPE bottles and picked up (DWTPs A and B) or shipped overnight (DWTP C) on a weekly basis. All samples were stored at room temperature until they were analyzed (within 1 week of receipt). PFAS losses during storage were negligible on the basis of results of a 70 day holding study at room temperature. On August 18, 2014, grab samples were collected at DWTP C after each unit process in the treatment train [raw water ozonation, coagulation/flocculation/sedimentation, settled water ozonation, biological activated carbon (BAC) filtration, and disinfection by medium-pressure UV lamps and free chlorine]. Operational conditions of DWTP C on the sampling day are listed in Table S2. Samples were collected in 1 L HDPE bottles and stored at room temperature until they were analyzed. On the same day, grab samples of CFR water were collected in six 20 L HDPE carboys at William O. Huske Lock and Dam downstream of a PFAS manufacturing site and stored at 4 °C until use in PAC adsorption experiments (background water matrix characteristics listed in Table S3).

Adsorption Experiments. Adsorption of PFASs by PAC was studied in batch reactors (amber glass bottles, 0.45 L of CFR water). PFECA adsorption was studied at ambient concentrations (~1000 ng/L PFPrOPrA, chromatographic peak areas of other PFECAs being approximately 10–800%

of the PFPrOPrA area). Legacy PFASs were present at low concentrations (<40 ng/L) and spiked into CFR water at ~1000 ng/L each. Data from spiked and nonspiked experiments showed that the added legacy PFASs and methanol (1 ppm) from the primary stock solution did not affect native PFECA removal. A thermally activated, wood-based PAC (PicaHydro MP23, PICA USA, Columbus, OH; mean diameter of 12 μm, BET surface area of 1460 m²/g)³⁰ proven to be effective for PFAS removal in a prior study²⁹ was used at doses of 30, 60, and 100 mg/L. These doses represent the upper feasible end for drinking water treatment. Samples were taken prior to and periodically after PAC addition for PFAS analysis. PFAS losses in PAC-free blanks were negligible.

PFAS Analysis. Information about analytical standards and liquid chromatography–tandem mass spectrometry (LC–MS/MS) methods for PFAS quantification is provided in the Supporting Information.

RESULTS AND DISCUSSION

Occurrence of PFASs in Drinking Water Sources. Mean PFAS concentrations in source water of three DWTPs treating surface water from the CFR watershed are shown in Figure 1.

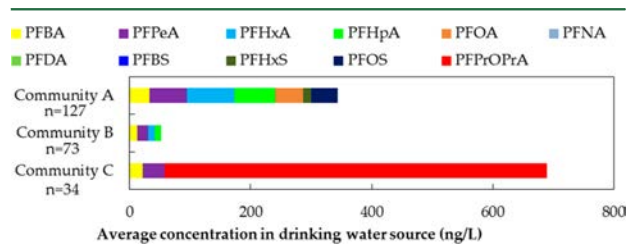


Figure 1. Occurrence of PFASs at drinking water intakes in the CFR watershed. Concentrations represent averages of samples collected between June and December 2013. Individual samples with concentrations below the quantitation limits (QLs) were considered as 0 when calculating averages, and average concentrations below the QLs were not plotted.

In communities A and B, only legacy PFASs were detected (mean \sum PFAS of 355 ng/L in community A and 62 ng/L in community B). Detailed concentration data are shown in Table S6 and Figure S3. In community A, PFCAs with four to eight total carbons, perfluorohexanesulfonic acid (PFHxS), and PFOS were detected at mean concentrations above the quantitation limits (QLs). During the 127 day sampling campaign, the sum concentration of PFOA and PFOS exceeded the USEPA HAL of 70 ng/L on 57 days. The mean sum concentration of PFOA and PFOS over the entire study period was 90 ng/L, with approximately equal contributions from PFOS (44 ng/L) and PFOA (46 ng/L). Maximum PFOS and PFOA concentrations were 346 and 137 ng/L, respectively. Similar PFOS and PFOA concentrations were observed in the same area in 2006,³¹ suggesting that PFAS source(s) upstream of community A have continued negative impacts on drinking water quality. Also, our data show that legacy PFASs remain as surface water contaminants of concern even though their production was recently phased out in the United States. It is important to note, however, that among the PFCAs that were measured in both 2006 and 2013 (PFHxA to PFDA), the PFCA speciation shifted from long-chain (~80–85% C_nF_{2n+1}COOH; n = 7–9) in 2006 to short-chain (76% C_nF_{2n+1}COOH; n = 5–6) in 2013. In contrast, the PFSA speciation was dominated by PFOS in both 2006 and 2013.

Relating total PFAS concentration to average daily streamflow (Figure S4) illustrated a general trend of low PFAS concentrations at high flow, and high concentrations at low flow, consistent with the hypothesis of one or more upstream point sources.

In community B, perfluorobutanoic acid (PFBA) and perfluoropentanoic acid (PFPeA) were most frequently detected with mean concentrations of 12 and 19 ng/L, respectively. Mean PFOA and PFOS concentrations were below the Q_Ls, and the maximum sum concentration of PFOA and PFOS was 59 ng/L. Lower PFAS concentrations in community B relative to community A can be explained by the absence of substantive PFAS sources between the two communities, dilution by tributaries, and the buffering effect of Jordan Lake, a large reservoir located between communities A and B.

In community C (downstream of a PFAS manufacturing site), only mean concentrations of PFBA and PFPeA were above the Q_Ls. The relatively low concentrations of legacy PFASs in the finished drinking water of community C are consistent with results from the USEPA's third unregulated contaminant monitoring rule for this DWTP.³² However, high concentrations of PFPrOPrA were detected (up to ~4500 ng/L). The average PFPrOPrA concentration (631 ng/L) was approximately 8 times the average summed PFCA and PFSA concentrations (79 ng/L). Other PFECAs had not yet been identified at the time of analysis. Similar to communities A and B, the highest PFAS concentrations for community C were also observed at low flow (Figure S4). Stream flow data were used in conjunction with PFPrOPrA concentration data to determine PFPrOPrA mass fluxes at the intake of DWTP C. Daily PFPrOPrA mass fluxes ranged from 0.6 to 24 kg/day with a mean of 5.9 kg/day.

Fate of PFASs in Conventional and Advanced Water Treatment Processes. To investigate whether PFASs can be removed from impacted source water, samples from DWTP C were collected at the intake and after each treatment step. Results in Figure 2 suggest conventional and advanced treatment processes (coagulation/flocculation/sedimentation, raw and settled water ozonation, BAC filtration, and disinfection by medium-pressure UV lamps and free chlorine) did not remove legacy PFASs, consistent with previous studies.^{22–26} The data further illustrate that no measurable PFECA removal occurred in this DWTP. Concentrations of some PFCAs, PFSAs, PFMOPrA, PFPrOPrA, and PFMOAA may have increased after ozonation, possibly because of the oxidation of precursor compounds.²⁵ Disinfection with medium-pressure UV lamps and free chlorine (located between the BAC effluent and the finished water) may have decreased concentrations of PFMOAA, PFMOPrA, PFMOBA, and PFPrOPrA, but only to a limited extent. Small concentration changes between treatment processes may also be related to temporal changes in source water PFAS concentrations that occurred in the time frame corresponding to the hydraulic residence time of the DWTP.

Results in Figure 2 further illustrate that the PFAS signature of the August 2014 samples was similar to the mean PFAS signature observed during the 2013 sampling campaigns shown in Figure 1; i.e., PFPrOPrA concentrations (400–500 ng/L) greatly exceeded legacy PFAS concentrations. Moreover, three PFECAs (PFMOAA, PFO2HxA, and PFO3OA) exhibited peak areas 2–113 times greater than that of PFPrOPrA (Figure 2b).

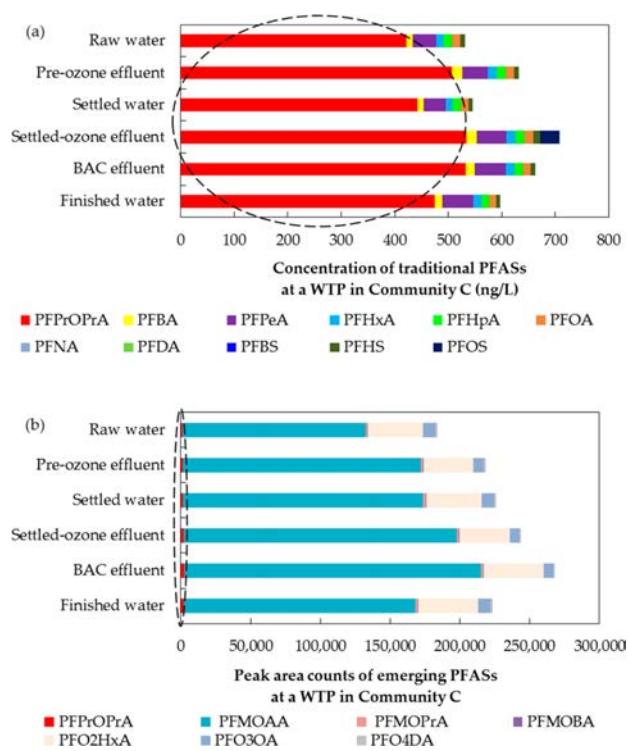


Figure 2. Fate of (a) legacy PFASs and PFPrOPrA and (b) PFECAs through a full-scale water treatment plant. Because authentic standards were not available for PFECAs other than PFPrOPrA, chromatographic peak area counts are shown in panel b. PFPrOPrA data are shown in both panels and highlighted with dashed ovals for reference. Compounds with concentrations below the Q_Ls were not plotted.

The existence of high levels of emerging PFASs suggests a need for their incorporation into routine monitoring.

Adsorption of PFASs by PAC. PAC can effectively remove long-chain PFCAs and PFSAs, but its effectiveness decreases with decreasing PFAS chain length.^{24,25,29} It is unclear, however, how the presence of ether group(s) in PFECAs impacts adsorbability. After a contact time of 1 h, a PAC dose of 100 mg/L achieved >80% removal of legacy PFCAs with total carbon chain lengths of ≥ 7 . At the same PAC dose, removals were 95% for PFO4DA and 54% for PFO3OA, but <40% for other PFECAs. Detailed removal percentage data as a function of PAC contact time are shown in Figure S5. There was no meaningful removal of PFMOBA or PFMOPrA, and the variability shown in Figure S5 is most likely associated with analytical variability. PFMOAA could not be quantified by the analytical method used for these experiments; however, on the basis of the observations that PFAS adsorption decreases with decreasing carbon chain length and that PFECAs with one or two more carbon atoms than PFMOAA (i.e., PFMOPrA and PFMOBA) exhibited negligible removal (Figure 3), it is expected that PFMOAA adsorption is also negligible under the tested conditions.

To compare the affinity of different PFASs for PAC, PFAS removal percentages were plotted as a function of PFAS chain length [the sum of carbon (including branched), ether oxygen, and sulfur atoms] (Figure 3b). The adsorbability of both legacy and emerging PFASs increased with increasing chain length. PFSAs were more readily removed than PFCAs of matching chain length, a result that agrees with those of previous

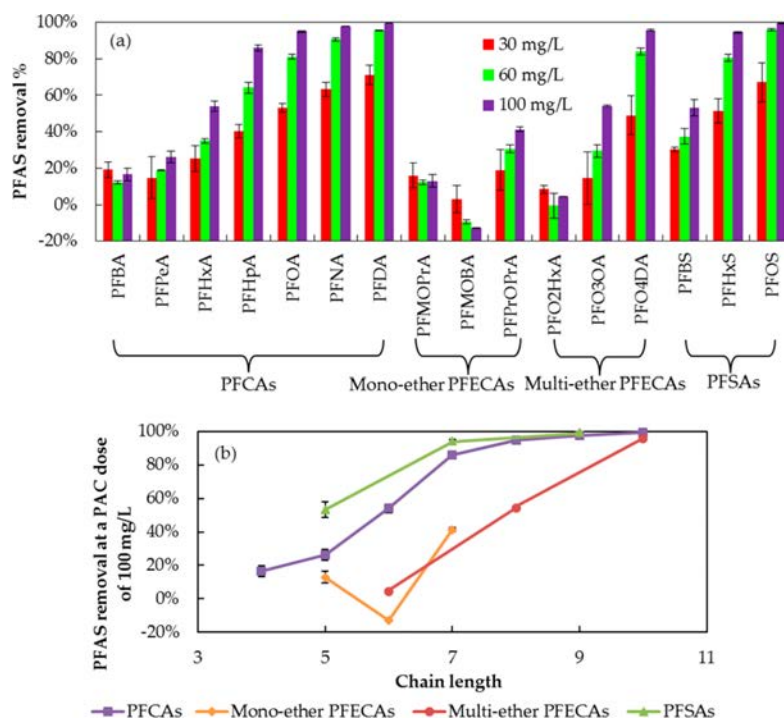


Figure 3. PFAS adsorption on PAC (a) at carbon doses of 30, 60, and 100 mg/L and (b) as a function of PFAS chain length. The PAC contact time in CFR water was 1 h. Legacy PFASs were spiked at ~ 1000 ng/L, and the emerging PFASs were at ambient concentrations. Figures show average PFAS removal percentages, and error bars show one standard deviation of replicate experiments.

studies.^{24,25,29} PFECAs exhibited adsorbabilities lower than those of PFCAs of the same chain length (e.g., PFMOBA < PFHxA), suggesting that the replacement of a CF_2 group with an ether oxygen atom decreases the affinity of PFASs for PAC. However, the replacement of additional CF_2 groups with ether groups resulted in small or negligible affinity changes among the studied PFECAs (e.g., PFMOBA \sim PFO2HxA, PFPrOPrA \sim PFO3OA). Alternatively, if only the number of perfluorinated carbons were considered as a basis of comparing adsorbability, the interpretation would be different. In that case, with the same number of perfluorinated carbons, PFCAs have an affinity for PAC higher than that of monoether PFECAs (e.g., PFPeA > PFMOBA) but an affinity lower than that of multi-ether PFECAs (e.g., PFPeA < PFO3OA).

To the best of our knowledge, this is the first paper reporting the behavior of recently identified PFECAs in water treatment processes. We show that PFECAs dominated the PFAS signature in a drinking water source downstream of a fluorochemical manufacturer and that PFECA removal by many conventional and advanced treatment processes was negligible. Our adsorption data further show that PFPrOPrA (“GenX”) is less adsorbable than PFOA, which it is replacing. Thus, PFPrOPrA presents a greater drinking water treatment challenge than PFOA does. The detection of potentially high levels of PFECAs, the continued presence of high levels of legacy PFASs, and the difficulty of effectively removing legacy PFASs and PFECAs with many water treatment processes suggest the need for broader discharge control and contaminant monitoring.

■ ASSOCIATED CONTENT

📄 Supporting Information

The Supporting Information is available free of charge on the ACS Publications website at DOI: [10.1021/acs.estlett.6b00398](https://doi.org/10.1021/acs.estlett.6b00398).

Six tables, five figures, information about PFASs, analytical methods, and detailed results (PDF)

■ AUTHOR INFORMATION

Corresponding Author

*E-mail: msun8@unc.edu. Phone: 704-687-1723.

ORCID

Mei Sun: [0000-0001-5854-9862](https://orcid.org/0000-0001-5854-9862)

Notes

The views expressed in this article are those of the authors and do not necessarily represent the views or policies of the USEPA.

The authors declare no competing financial interest.

■ ACKNOWLEDGMENTS

This research was supported by the National Science Foundation (Grant 1550222), the Water Research Foundation (Project 4344), and the North Carolina Urban Water Consortium.

■ REFERENCES

- (1) Hu, X. C.; Andrews, D. Q.; Lindstrom, A. B.; Bruton, T. A.; Schaidler, L. A.; Grandjean, P.; Lohmann, R.; Carignan, C. C.; Blum, A.; Balan, S. A.; et al. Detection of poly- and perfluoroalkyl substances (PFASs) in U.S. drinking water linked to industrial sites, military fire training areas, and wastewater treatment plants. *Environ. Sci. Technol. Lett.* **2016**, *3* (10), 344–350.

- (2) Buck, R. C.; Franklin, J.; Berger, U.; Conder, J. M.; Cousins, I. T.; de Voogt, P.; Jensen, A. A.; Kannan, K.; Mabury, S. A.; van Leeuwen, S. P. J. Perfluoroalkyl and polyfluoroalkyl substances in the environment: Terminology, classification, and origins. *Integr. Environ. Assess. Manage.* **2011**, *7* (4), 513–541.
- (3) Kennedy, G. L.; Butenhoff, J. L.; Olsen, G. W.; O'Connor, J. C.; Seacat, A. M.; Perkins, R. G.; Biegel, L. B.; Murphy, S. R.; Farrar, D. G. The toxicology of perfluorooctanoate. *Crit. Rev. Toxicol.* **2004**, *34* (4), 351–384.
- (4) Borg, D.; Hakansson, H. Environmental and health risk assessment of perfluoroalkylated and polyfluoroalkylated substances (PFASs) in Sweden. Report 6513; The Swedish Environmental Protection Agency: Stockholm, 2012.
- (5) Drinking water health advisory for perfluorooctanoic acid (PFOA). Report 822-R-16-005; U.S. Environmental Protection Agency: Washington, DC, 2016.
- (6) Drinking water health advisory for perfluorooctane sulfonate (PFOS). Report 822-R-16-004; U.S. Environmental Protection Agency: Washington, DC, 2016.
- (7) Scheringer, M.; Trier, X.; Cousins, I. T.; de Voogt, P.; Fletcher, T.; Wang, Z.; Webster, T. F. Helsingør Statement on poly- and perfluorinated alkyl substances (PFASs). *Chemosphere* **2014**, *114*, 337–339.
- (8) Wang, Z.; Cousins, I. T.; Scheringer, M.; Hungerbühler, K. Fluorinated alternatives to long-chain perfluoroalkyl carboxylic acids (PFCAs), perfluoroalkane sulfonic acids (PFASs) and their potential precursors. *Environ. Int.* **2013**, *60*, 242–248.
- (9) Wang, Z.; Cousins, I. T.; Scheringer, M.; Hungerbuehler, K. Hazard assessment of fluorinated alternatives to long-chain perfluoroalkyl acids (PFAAs) and their precursors: Status quo, ongoing challenges and possible solutions. *Environ. Int.* **2015**, *75*, 172–179.
- (10) Barzen-Hanson, K. A.; Field, J. A. Discovery and implications of C2 and C3 perfluoroalkyl sulfonates in aqueous film-forming foams and groundwater. *Environ. Sci. Technol. Lett.* **2015**, *2* (4), 95–99.
- (11) Strynar, M.; Dagnino, S.; McMahan, R.; Liang, S.; Lindstrom, A.; Andersen, E.; McMillan, L.; Thurman, M.; Ferrer, L.; Ball, C. Identification of novel perfluoroalkyl ether carboxylic acids (PFECAs) and sulfonic acids (PFESAs) in natural waters using accurate mass time-of-flight mass spectrometry (TOFMS). *Environ. Sci. Technol.* **2015**, *49* (19), 11622–11630.
- (12) Miyake, Y.; Yamashita, N.; Rostkowski, P.; So, M. K.; Taniyasu, S.; Lam, P. K. S.; Kannan, K. Determination of trace levels of total fluorine in water using combustion ion chromatography for fluorine: A mass balance approach to determine individual perfluorinated chemicals in water. *J. Chromatogr. A* **2007**, *1143* (1–2), 98–104.
- (13) Wagner, A.; Raue, B.; Brauch, H.-J.; Worch, E.; Lange, F. T. Determination of adsorbable organic fluorine from aqueous environmental samples by adsorption to polystyrene-divinylbenzene based activated carbon and combustion ion chromatography. *J. Chromatogr. A* **2013**, *1295*, 82–89.
- (14) Willach, S.; Brauch, H.-J.; Lange, F. T. Contribution of selected perfluoroalkyl and polyfluoroalkyl substances to the adsorbable organically bound fluorine in German rivers and in a highly contaminated groundwater. *Chemosphere* **2016**, *145*, 342–350.
- (15) Heydebreck, F.; Tang, J.; Xie, Z.; Ebinghaus, R. Alternative and legacy perfluoroalkyl substances: Differences between european and chinese river/estuary systems. *Environ. Sci. Technol.* **2015**, *49* (14), 8386–8395.
- (16) Gannon, S. A.; Fasano, W. J.; Mawn, M. P.; Nabb, D. L.; Buck, R. C.; Buxton, L. W.; Jepson, G. W.; Frame, S. R. Absorption, distribution, metabolism, excretion, and kinetics of 2,3,3,3-tetrafluoro-2-(heptafluoropropoxy)propanoic acid ammonium salt following a single dose in rat, mouse, and cynomolgus monkey. *Toxicology* **2016**, *340*, 1–9.
- (17) Hoke, R. A.; Ferrell, B. D.; Sloman, T. L.; Buck, R. C.; Buxton, L. W. Aquatic hazard, bioaccumulation and screening risk assessment for ammonium 2,3,3,3-tetrafluoro-2-(heptafluoropropoxy)-propanoate. *Chemosphere* **2016**, *149*, 336–342.
- (18) Caverly Rae, J. M.; Craig, L.; Slone, T. W.; Frame, S. R.; Buxton, L. W.; Kennedy, G. L. Evaluation of chronic toxicity and carcinogenicity of ammonium 2,3,3,3-tetrafluoro-2-(heptafluoropropoxy)-propanoate in Sprague–Dawley rats. *Toxicol. Rep.* **2015**, *2*, 939–949.
- (19) Wang, J.; Wang, X.; Sheng, N.; Zhou, X.; Cui, R.; Zhang, H.; Dai, J. RNA-sequencing analysis reveals the hepatotoxic mechanism of perfluoroalkyl alternatives, HFPO2 and HFPO4, following exposure in mice. *J. Appl. Toxicol.* **2016**.
- (20) Gomis, M. L.; Wang, Z.; Scheringer, M.; Cousins, I. T. A modeling assessment of the physicochemical properties and environmental fate of emerging and novel per- and polyfluoroalkyl substances. *Sci. Total Environ.* **2015**, *505*, 981–991.
- (21) Rayne, S.; Forest, K. Perfluoroalkyl sulfonic and carboxylic acids: A critical review of physicochemical properties, levels and patterns in waters and wastewaters, and treatment methods. *J. Environ. Sci. Health, Part A: Toxic/Hazard. Subst. Environ. Eng.* **2009**, *44* (12), 1145–1199.
- (22) Quiñones, O.; Snyder, S. A. Occurrence of perfluoroalkyl carboxylates and sulfonates in drinking water utilities and related waters from the United States. *Environ. Sci. Technol.* **2009**, *43* (24), 9089–9095.
- (23) Shivakoti, B. R.; Fujii, S.; Nozoe, M.; Tanaka, S.; Kunacheva, C. Perfluorinated chemicals (PFCs) in water purification plants (WPPs) with advanced treatment processes. *Water Sci. Technol.: Water Supply* **2010**, *10* (1), 87–95.
- (24) Eschauzier, C.; Beerendonk, E.; Scholte-Veenendaal, P.; De Voogt, P. Impact of treatment processes on the removal of perfluoroalkyl acids from the drinking water production chain. *Environ. Sci. Technol.* **2012**, *46* (3), 1708–1715.
- (25) Rahman, M. F.; Peldszus, S.; Anderson, W. B. Behaviour and fate of perfluoroalkyl and polyfluoroalkyl substances (PFASs) in drinking water treatment: A review. *Water Res.* **2014**, *50*, 318–340.
- (26) Appleman, T. D.; Higgins, C. P.; Quiñones, O.; Vanderford, B. J.; Kolstad, C.; Zeigler-Holady, J. C.; Dickenson, E. R. V. Treatment of poly- and perfluoroalkyl substances in U.S. full-scale water treatment systems. *Water Res.* **2014**, *51*, 246–255.
- (27) Merino, N.; Qu, Y.; Deeb, R. A.; Hawley, E. L.; Hoffmann, M. R.; Mahendra, S. Degradation and removal methods for perfluoroalkyl and polyfluoroalkyl substances in water. *Environ. Eng. Sci.* **2016**, *33* (9), 615–649.
- (28) Appleman, T. D.; Dickenson, E. R. V.; Bellona, C.; Higgins, C. P. Nanofiltration and granular activated carbon treatment of perfluoroalkyl acids. *J. Hazard. Mater.* **2013**, *260*, 740–746.
- (29) Dudley, L. A.; Arevalo, E. C.; Knappe, D. R. U. *Removal of perfluoroalkyl substances by PAC adsorption and anion exchange*; Water Research Foundation: Denver, 2015.
- (30) Dunn, S. E.; Knappe, D. R. U. *Disinfection by-product precursor and micropollutant removal by powdered activated carbon*; Water Research Foundation: Denver, 2013.
- (31) Nakayama, S.; Strynar, M. J.; Helfant, L.; Egeghy, P.; Ye, X.; Lindstrom, A. B. Perfluorinated compounds in the Cape Fear drainage basin in North Carolina. *Environ. Sci. Technol.* **2007**, *41* (15), 5271–5276.
- (32) Unregulated contaminant monitoring rule 3 (UCMR 3). <http://water.epa.gov/lawsregs/rulesregs/sdwa/ucmr/ucmr3/>; U.S. Environmental Protection Agency: Washington, DC (accessed July 29, 2016).

Legacy and Emerging Perfluoroalkyl Substances Are Important Drinking Water Contaminants in the Cape Fear River Watershed of North Carolina

Mei Sun,^{*,†,‡,§} Elisa Arevalo,[‡] Mark Strynar,[§] Andrew Lindstrom,[§] Michael Richardson,^{||} Ben Kearns,^{||} Adam Pickett,[⊥] Chris Smith,[#] and Detlef R. U. Knappe[‡]

[†]Department of Civil and Environmental Engineering, University of North Carolina at Charlotte, Charlotte, North Carolina 28223, United States

[‡]Department of Civil, Construction, and Environmental Engineering, North Carolina State University, Raleigh, North Carolina 27695, United States

[§]National Exposure Research Laboratory, U.S. Environmental Protection Agency Research, Triangle Park, North Carolina 27711, United States


^{||}Cape Fear Public Utility Authority, Wilmington, North Carolina 28403, United States

[⊥]Town of Pittsboro, Pittsboro, North Carolina 27312, United States

[#]Fayetteville Public Works Commission, Fayetteville, North Carolina 28301, United States

Supporting Information

ABSTRACT: Long-chain per- and polyfluoroalkyl substances (PFASs) are being replaced by short-chain PFASs and fluorinated alternatives. For ten legacy PFASs and seven recently discovered perfluoroalkyl ether carboxylic acids (PFECAs), we report (1) their occurrence in the Cape Fear River (CFR) watershed, (2) their fate in water treatment processes, and (3) their adsorbability on powdered activated carbon (PAC). In the headwater region of the CFR basin, PFECAs were not detected in raw water of a drinking water treatment plant (DWTP), but concentrations of legacy PFASs were high. The U.S. Environmental Protection Agency's lifetime health advisory level (70 ng/L) for perfluorooctanesulfonic acid and perfluorooctanoic acid (PFOA) was exceeded on 57 of 127 sampling days. In raw water of a DWTP downstream of a PFAS manufacturer, the mean concentration of perfluoro-2-propoxypropanoic acid (PFPrOPrA), a replacement for PFOA, was 631 ng/L ($n = 37$). Six other PFECAs were detected, with three exhibiting chromatographic peak areas up to 15 times that of PFPrOPrA. At this DWTP, PFECA removal by coagulation, ozonation, biofiltration, and disinfection was negligible. The adsorbability of PFASs on PAC increased with increasing chain length. Replacing one CF_2 group with an ether oxygen decreased the affinity of PFASs for PAC, while replacing additional CF_2 groups did not lead to further affinity changes.

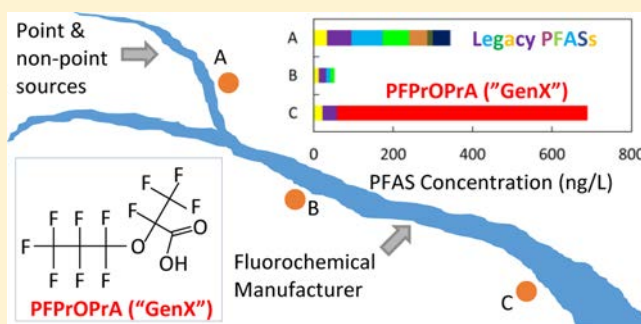

INTRODUCTION

Per- and polyfluoroalkyl substances (PFASs) are extensively used in the production of plastics, water/stain repellents, firefighting foams, and food-contact paper coatings. The widespread occurrence of PFASs in drinking water sources is closely related to the presence of sources such as industrial sites, military fire training areas, civilian airports, and wastewater treatment plants.¹ Until 2000, long-chain perfluoroalkyl sulfonic acids [$\text{C}_n\text{F}_{2n+1}\text{SO}_3\text{H}$; $n \geq 6$ (PFASs)] and perfluoroalkyl carboxylic acids [$\text{C}_n\text{F}_{2n+1}\text{COOH}$; $n \geq 7$ (PFCAs)] were predominantly used.² Accumulating evidence about the ecological persistence and human health effects associated with exposure to long-chain PFASs^{3,4} has led to an increased level of regulatory attention. Recently, the U.S. Environmental Protection Agency (USEPA) established a lifetime health

advisory level (HAL) of 70 ng/L for the sum of perfluorooctanoic acid (PFOA) and perfluorooctanesulfonic acid (PFOS) concentrations in drinking water.^{5,6} Over the past decade, production of long-chain PFASs has declined in Europe and North America, and manufacturers are moving toward short-chain PFASs and fluorinated alternatives.^{7–10} Some fluorinated alternatives were recently identified,^{8,11} but others remain unknown^{12–14} because they are either proprietary or manufacturing byproducts.

Received: October 13, 2016

Revised: November 8, 2016

Accepted: November 10, 2016

Published: November 10, 2016

One group of fluorinated alternatives, perfluoroalkyl ether carboxylic acids (PFECAs), was recently discovered in the Cape Fear River (CFR) downstream of a PFAS manufacturing facility.¹¹ Identified PFECAs included perfluoro-2-methoxyacetic acid (PFMOAA), perfluoro-3-methoxypropanoic acid (PFMOPrA), perfluoro-4-methoxybutanoic acid (PFMOBA), perfluoro-2-propoxypropanoic acid (PFPrOPrA), perfluoro-(3,5-dioxahexanoic) acid (PFO2HxA), perfluoro(3,5,7-trioxooctanoic) acid (PFO3OA), and perfluoro(3,5,7,9-tetraoxadecanoic) acid (PFO4DA) (Table S1 and Figure S1). The ammonium salt of PFPrOPrA is a known PFOA alternative¹⁵ that has been produced since 2010 with the trade name “GenX”. To the best of our knowledge, the only other published PFECA occurrence data are for PFPrOPrA in Europe and China,¹⁵ and no published data about the fate of PFECAs during water treatment are available. Except for a few studies (most by the manufacturer),^{16–20} little is known about the toxicity, pharmacokinetic behavior, or environmental fate and transport of PFECAs.

The strong C–F bond makes PFASs refractory to abiotic and biotic degradation,²¹ and most water treatment processes are ineffective for legacy PFAS removal.^{22–27} Processes capable of removing PFCAs and PFASs include nanofiltration,²⁸ reverse osmosis,²⁵ ion exchange,^{28,29} and activated carbon adsorption,^{28,29} with activated carbon adsorption being the most widely employed treatment option.

The objectives of this research were (1) to identify and quantify the presence of legacy PFASs and emerging PFECAs in drinking water sources, (2) to assess PFAS removal by conventional and advanced processes in a full-scale drinking water treatment plant (DWTP), and (3) to evaluate the adsorbability of PFASs on powdered activated carbon (PAC).

MATERIALS AND METHODS

Water Samples. Source water of three DWTPs treating surface water in the CFR watershed was sampled between June 14 and December 2, 2013 (Figure S2). Samples were collected from the raw water tap at each DWTP daily as either 8 h composites (DWTP A, 127 samples) or 24 h composites (DWTP B, 73 samples; DWTP C, 34 samples). Samples were collected in 250 mL HDPE bottles and picked up (DWTPs A and B) or shipped overnight (DWTP C) on a weekly basis. All samples were stored at room temperature until they were analyzed (within 1 week of receipt). PFAS losses during storage were negligible on the basis of results of a 70 day holding study at room temperature. On August 18, 2014, grab samples were collected at DWTP C after each unit process in the treatment train [raw water ozonation, coagulation/flocculation/sedimentation, settled water ozonation, biological activated carbon (BAC) filtration, and disinfection by medium-pressure UV lamps and free chlorine]. Operational conditions of DWTP C on the sampling day are listed in Table S2. Samples were collected in 1 L HDPE bottles and stored at room temperature until they were analyzed. On the same day, grab samples of CFR water were collected in six 20 L HDPE carboys at William O. Huske Lock and Dam downstream of a PFAS manufacturing site and stored at 4 °C until use in PAC adsorption experiments (background water matrix characteristics listed in Table S3).

Adsorption Experiments. Adsorption of PFASs by PAC was studied in batch reactors (amber glass bottles, 0.45 L of CFR water). PFECA adsorption was studied at ambient concentrations (~1000 ng/L PFPrOPrA, chromatographic peak areas of other PFECAs being approximately 10–800%

of the PFPrOPrA area). Legacy PFASs were present at low concentrations (<40 ng/L) and spiked into CFR water at ~1000 ng/L each. Data from spiked and nonspiked experiments showed that the added legacy PFASs and methanol (1 ppm) from the primary stock solution did not affect native PFECA removal. A thermally activated, wood-based PAC (PicaHydro MP23, PICA USA, Columbus, OH; mean diameter of 12 μm , BET surface area of 1460 m^2/g)³⁰ proven to be effective for PFAS removal in a prior study²⁹ was used at doses of 30, 60, and 100 mg/L. These doses represent the upper feasible end for drinking water treatment. Samples were taken prior to and periodically after PAC addition for PFAS analysis. PFAS losses in PAC-free blanks were negligible.

PFAS Analysis. Information about analytical standards and liquid chromatography–tandem mass spectrometry (LC–MS/MS) methods for PFAS quantification is provided in the Supporting Information.

RESULTS AND DISCUSSION

Occurrence of PFASs in Drinking Water Sources. Mean PFAS concentrations in source water of three DWTPs treating surface water from the CFR watershed are shown in Figure 1.

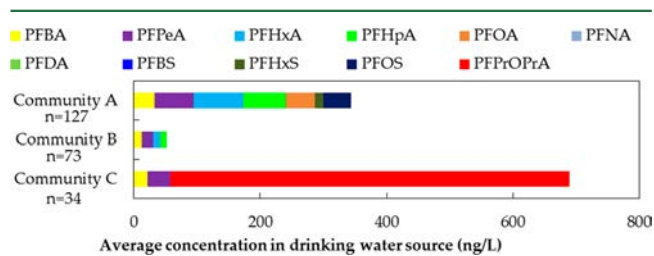


Figure 1. Occurrence of PFASs at drinking water intakes in the CFR watershed. Concentrations represent averages of samples collected between June and December 2013. Individual samples with concentrations below the quantitation limits (QLs) were considered as 0 when calculating averages, and average concentrations below the QLs were not plotted.

In communities A and B, only legacy PFASs were detected (mean \sum PFAS of 355 ng/L in community A and 62 ng/L in community B). Detailed concentration data are shown in Table S6 and Figure S3. In community A, PFCAs with four to eight total carbons, perfluorohexanesulfonic acid (PFHxS), and PFOS were detected at mean concentrations above the quantitation limits (QLs). During the 127 day sampling campaign, the sum concentration of PFOA and PFOS exceeded the USEPA HAL of 70 ng/L on 57 days. The mean sum concentration of PFOA and PFOS over the entire study period was 90 ng/L, with approximately equal contributions from PFOS (44 ng/L) and PFOA (46 ng/L). Maximum PFOS and PFOA concentrations were 346 and 137 ng/L, respectively. Similar PFOS and PFOA concentrations were observed in the same area in 2006,³¹ suggesting that PFAS source(s) upstream of community A have continued negative impacts on drinking water quality. Also, our data show that legacy PFASs remain as surface water contaminants of concern even though their production was recently phased out in the United States. It is important to note, however, that among the PFCAs that were measured in both 2006 and 2013 (PFHxA to PFDA), the PFCA speciation shifted from long-chain (~80–85% $\text{C}_n\text{F}_{2n+1}\text{COOH}$; $n = 7–9$) in 2006 to short-chain (76% $\text{C}_n\text{F}_{2n+1}\text{COOH}$; $n = 5–6$) in 2013. In contrast, the PFSA speciation was dominated by PFOS in both 2006 and 2013.

Relating total PFAS concentration to average daily streamflow (Figure S4) illustrated a general trend of low PFAS concentrations at high flow, and high concentrations at low flow, consistent with the hypothesis of one or more upstream point sources.

In community B, perfluorobutanoic acid (PFBA) and perfluoropentanoic acid (PFPeA) were most frequently detected with mean concentrations of 12 and 19 ng/L, respectively. Mean PFOA and PFOS concentrations were below the Q_Ls, and the maximum sum concentration of PFOA and PFOS was 59 ng/L. Lower PFAS concentrations in community B relative to community A can be explained by the absence of substantive PFAS sources between the two communities, dilution by tributaries, and the buffering effect of Jordan Lake, a large reservoir located between communities A and B.

In community C (downstream of a PFAS manufacturing site), only mean concentrations of PFBA and PFPeA were above the Q_Ls. The relatively low concentrations of legacy PFASs in the finished drinking water of community C are consistent with results from the USEPA's third unregulated contaminant monitoring rule for this DWTP.³² However, high concentrations of PFPrOPrA were detected (up to ~4500 ng/L). The average PFPrOPrA concentration (631 ng/L) was approximately 8 times the average summed PFCA and PFSA concentrations (79 ng/L). Other PFECAs had not yet been identified at the time of analysis. Similar to communities A and B, the highest PFAS concentrations for community C were also observed at low flow (Figure S4). Stream flow data were used in conjunction with PFPrOPrA concentration data to determine PFPrOPrA mass fluxes at the intake of DWTP C. Daily PFPrOPrA mass fluxes ranged from 0.6 to 24 kg/day with a mean of 5.9 kg/day.

Fate of PFASs in Conventional and Advanced Water Treatment Processes. To investigate whether PFASs can be removed from impacted source water, samples from DWTP C were collected at the intake and after each treatment step. Results in Figure 2 suggest conventional and advanced treatment processes (coagulation/flocculation/sedimentation, raw and settled water ozonation, BAC filtration, and disinfection by medium-pressure UV lamps and free chlorine) did not remove legacy PFASs, consistent with previous studies.^{22–26} The data further illustrate that no measurable PFECA removal occurred in this DWTP. Concentrations of some PFCAs, PFSAs, PFMOPrA, PFPrOPrA, and PFMOAA may have increased after ozonation, possibly because of the oxidation of precursor compounds.²⁵ Disinfection with medium-pressure UV lamps and free chlorine (located between the BAC effluent and the finished water) may have decreased concentrations of PFMOAA, PFMOPrA, PFMOBA, and PFPrOPrA, but only to a limited extent. Small concentration changes between treatment processes may also be related to temporal changes in source water PFAS concentrations that occurred in the time frame corresponding to the hydraulic residence time of the DWTP.

Results in Figure 2 further illustrate that the PFAS signature of the August 2014 samples was similar to the mean PFAS signature observed during the 2013 sampling campaigns shown in Figure 1; i.e., PFPrOPrA concentrations (400–500 ng/L) greatly exceeded legacy PFAS concentrations. Moreover, three PFECAs (PFMOAA, PFO2HxA, and PFO3OA) exhibited peak areas 2–113 times greater than that of PFPrOPrA (Figure 2b).

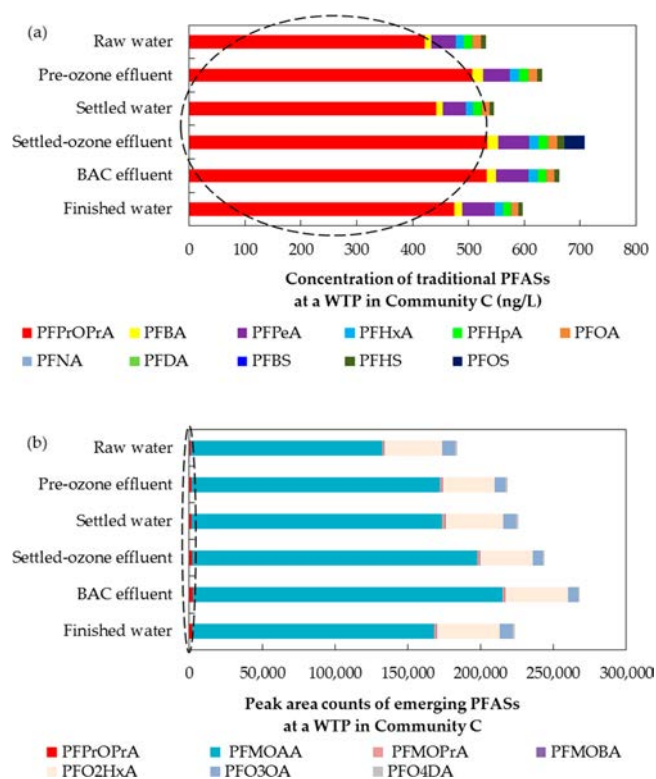


Figure 2. Fate of (a) legacy PFASs and PFPrOPrA and (b) PFECAs through a full-scale water treatment plant. Because authentic standards were not available for PFECAs other than PFPrOPrA, chromatographic peak area counts are shown in panel b. PFPrOPrA data are shown in both panels and highlighted with dashed ovals for reference. Compounds with concentrations below the Q_Ls were not plotted.

The existence of high levels of emerging PFASs suggests a need for their incorporation into routine monitoring.

Adsorption of PFASs by PAC. PAC can effectively remove long-chain PFCAs and PFSAs, but its effectiveness decreases with decreasing PFAS chain length.^{24,25,29} It is unclear, however, how the presence of ether group(s) in PFECAs impacts adsorbability. After a contact time of 1 h, a PAC dose of 100 mg/L achieved >80% removal of legacy PFCAs with total carbon chain lengths of ≥ 7 . At the same PAC dose, removals were 95% for PFO4DA and 54% for PFO3OA, but <40% for other PFECAs. Detailed removal percentage data as a function of PAC contact time are shown in Figure S5. There was no meaningful removal of PFMOBA or PFMOPrA, and the variability shown in Figure S5 is most likely associated with analytical variability. PFMOAA could not be quantified by the analytical method used for these experiments; however, on the basis of the observations that PFAS adsorption decreases with decreasing carbon chain length and that PFECAs with one or two more carbon atoms than PFMOAA (i.e., PFMOPrA and PFMOBA) exhibited negligible removal (Figure 3), it is expected that PFMOAA adsorption is also negligible under the tested conditions.

To compare the affinity of different PFASs for PAC, PFAS removal percentages were plotted as a function of PFAS chain length [the sum of carbon (including branched), ether oxygen, and sulfur atoms] (Figure 3b). The adsorbability of both legacy and emerging PFASs increased with increasing chain length. PFSAs were more readily removed than PFCAs of matching chain length, a result that agrees with those of previous

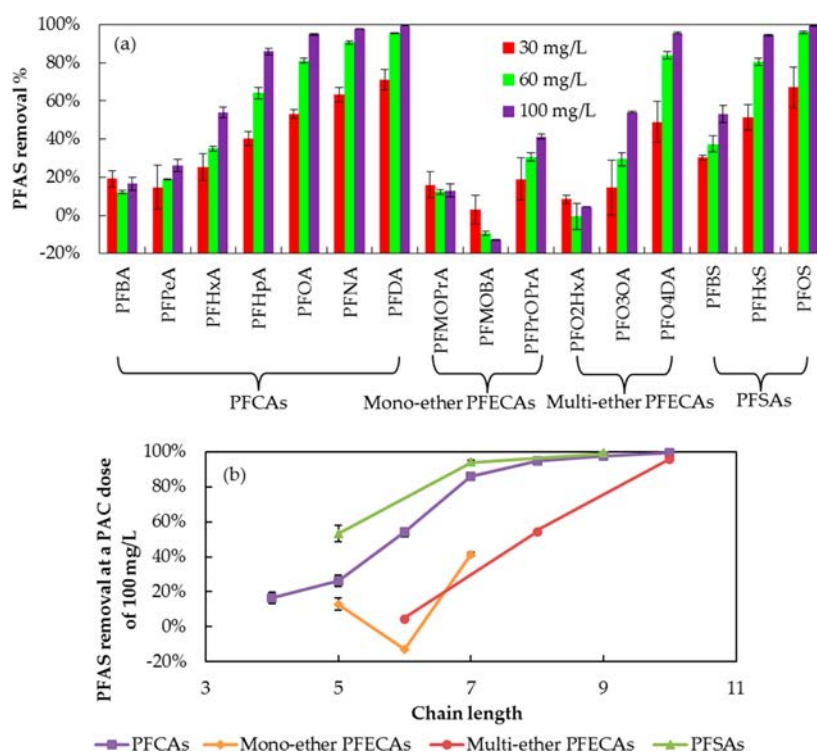


Figure 3. PFAS adsorption on PAC (a) at carbon doses of 30, 60, and 100 mg/L and (b) as a function of PFAS chain length. The PAC contact time in CFR water was 1 h. Legacy PFASs were spiked at ~ 1000 ng/L, and the emerging PFASs were at ambient concentrations. Figures show average PFAS removal percentages, and error bars show one standard deviation of replicate experiments.

studies.^{24,25,29} PFECAs exhibited adsorbabilities lower than those of PFCAs of the same chain length (e.g., PFMOBA < PFHxA), suggesting that the replacement of a CF_2 group with an ether oxygen atom decreases the affinity of PFASs for PAC. However, the replacement of additional CF_2 groups with ether groups resulted in small or negligible affinity changes among the studied PFECAs (e.g., PFMOBA \sim PFO2HxA, PFPrOPrA \sim PFO3OA). Alternatively, if only the number of perfluorinated carbons were considered as a basis of comparing adsorbability, the interpretation would be different. In that case, with the same number of perfluorinated carbons, PFCAs have an affinity for PAC higher than that of monoether PFECAs (e.g., PFPeA > PFMOBA) but an affinity lower than that of multi-ether PFECAs (e.g., PFPeA < PFO3OA).

To the best of our knowledge, this is the first paper reporting the behavior of recently identified PFECAs in water treatment processes. We show that PFECAs dominated the PFAS signature in a drinking water source downstream of a fluorochemical manufacturer and that PFECA removal by many conventional and advanced treatment processes was negligible. Our adsorption data further show that PFPrOPrA (“GenX”) is less adsorbable than PFOA, which it is replacing. Thus, PFPrOPrA presents a greater drinking water treatment challenge than PFOA does. The detection of potentially high levels of PFECAs, the continued presence of high levels of legacy PFASs, and the difficulty of effectively removing legacy PFASs and PFECAs with many water treatment processes suggest the need for broader discharge control and contaminant monitoring.

■ ASSOCIATED CONTENT

📄 Supporting Information

The Supporting Information is available free of charge on the ACS Publications website at DOI: 10.1021/acs.estlett.6b00398.

Six tables, five figures, information about PFASs, analytical methods, and detailed results (PDF)

■ AUTHOR INFORMATION

Corresponding Author

*E-mail: msun8@uncc.edu. Phone: 704-687-1723.

ORCID

Mei Sun: 0000-0001-5854-9862

Notes

The views expressed in this article are those of the authors and do not necessarily represent the views or policies of the USEPA.

The authors declare no competing financial interest.

■ ACKNOWLEDGMENTS

This research was supported by the National Science Foundation (Grant 1550222), the Water Research Foundation (Project 4344), and the North Carolina Urban Water Consortium.

■ REFERENCES

- (1) Hu, X. C.; Andrews, D. Q.; Lindstrom, A. B.; Bruton, T. A.; Schaidler, L. A.; Grandjean, P.; Lohmann, R.; Carignan, C. C.; Blum, A.; Balan, S. A.; et al. Detection of poly- and perfluoroalkyl substances (PFASs) in U.S. drinking water linked to industrial sites, military fire training areas, and wastewater treatment plants. *Environ. Sci. Technol. Lett.* **2016**, 3 (10), 344–350.

- (2) Buck, R. C.; Franklin, J.; Berger, U.; Conder, J. M.; Cousins, I. T.; de Voogt, P.; Jensen, A. A.; Kannan, K.; Mabury, S. A.; van Leeuwen, S. P. J. Perfluoroalkyl and polyfluoroalkyl substances in the environment: Terminology, classification, and origins. *Integr. Environ. Assess. Manage.* **2011**, *7* (4), 513–541.
- (3) Kennedy, G. L.; Butenhoff, J. L.; Olsen, G. W.; O'Connor, J. C.; Seacat, A. M.; Perkins, R. G.; Biegel, L. B.; Murphy, S. R.; Farrar, D. G. The toxicology of perfluorooctanoate. *Crit. Rev. Toxicol.* **2004**, *34* (4), 351–384.
- (4) Borg, D.; Hakansson, H. Environmental and health risk assessment of perfluoroalkylated and polyfluoroalkylated substances (PFASs) in Sweden. Report 6513; The Swedish Environmental Protection Agency: Stockholm, 2012.
- (5) Drinking water health advisory for perfluorooctanoic acid (PFOA). Report 822-R-16-005; U.S. Environmental Protection Agency: Washington, DC, 2016.
- (6) Drinking water health advisory for perfluorooctane sulfonate (PFOS). Report 822-R-16-004; U.S. Environmental Protection Agency: Washington, DC, 2016.
- (7) Scheringer, M.; Trier, X.; Cousins, I. T.; de Voogt, P.; Fletcher, T.; Wang, Z.; Webster, T. F. Helsingør Statement on poly- and perfluorinated alkyl substances (PFASs). *Chemosphere* **2014**, *114*, 337–339.
- (8) Wang, Z.; Cousins, I. T.; Scheringer, M.; Hungerbühler, K. Fluorinated alternatives to long-chain perfluoroalkyl carboxylic acids (PFCAs), perfluoroalkane sulfonic acids (PFASs) and their potential precursors. *Environ. Int.* **2013**, *60*, 242–248.
- (9) Wang, Z.; Cousins, I. T.; Scheringer, M.; Hungerbuehler, K. Hazard assessment of fluorinated alternatives to long-chain perfluoroalkyl acids (PFAAs) and their precursors: Status quo, ongoing challenges and possible solutions. *Environ. Int.* **2015**, *75*, 172–179.
- (10) Barzen-Hanson, K. A.; Field, J. A. Discovery and implications of C2 and C3 perfluoroalkyl sulfonates in aqueous film-forming foams and groundwater. *Environ. Sci. Technol. Lett.* **2015**, *2* (4), 95–99.
- (11) Strynar, M.; Dagnino, S.; McMahan, R.; Liang, S.; Lindstrom, A.; Andersen, E.; McMillan, L.; Thurman, M.; Ferrer, I.; Ball, C. Identification of novel perfluoroalkyl ether carboxylic acids (PFECAs) and sulfonic acids (PFESAs) in natural waters using accurate mass time-of-flight mass spectrometry (TOFMS). *Environ. Sci. Technol.* **2015**, *49* (19), 11622–11630.
- (12) Miyake, Y.; Yamashita, N.; Rostkowski, P.; So, M. K.; Taniyasu, S.; Lam, P. K. S.; Kannan, K. Determination of trace levels of total fluorine in water using combustion ion chromatography for fluorine: A mass balance approach to determine individual perfluorinated chemicals in water. *J. Chromatogr. A* **2007**, *1143* (1–2), 98–104.
- (13) Wagner, A.; Raue, B.; Brauch, H.-J.; Worch, E.; Lange, F. T. Determination of adsorbable organic fluorine from aqueous environmental samples by adsorption to polystyrene-divinylbenzene based activated carbon and combustion ion chromatography. *J. Chromatogr. A* **2013**, *1295*, 82–89.
- (14) Willach, S.; Brauch, H.-J.; Lange, F. T. Contribution of selected perfluoroalkyl and polyfluoroalkyl substances to the adsorbable organically bound fluorine in German rivers and in a highly contaminated groundwater. *Chemosphere* **2016**, *145*, 342–350.
- (15) Heydebreck, F.; Tang, J.; Xie, Z.; Ebinghaus, R. Alternative and legacy perfluoroalkyl substances: Differences between European and Chinese river/estuary systems. *Environ. Sci. Technol.* **2015**, *49* (14), 8386–8395.
- (16) Gannon, S. A.; Fasano, W. J.; Mawn, M. P.; Nabb, D. L.; Buck, R. C.; Buxton, L. W.; Jepson, G. W.; Frame, S. R. Absorption, distribution, metabolism, excretion, and kinetics of 2,3,3,3-tetrafluoro-2-(heptafluoropropoxy)propanoic acid ammonium salt following a single dose in rat, mouse, and cynomolgus monkey. *Toxicology* **2016**, *340*, 1–9.
- (17) Hoke, R. A.; Ferrell, B. D.; Sloman, T. L.; Buck, R. C.; Buxton, L. W. Aquatic hazard, bioaccumulation and screening risk assessment for ammonium 2,3,3,3-tetrafluoro-2-(heptafluoropropoxy)-propanoate. *Chemosphere* **2016**, *149*, 336–342.
- (18) Caverly Rae, J. M.; Craig, L.; Slone, T. W.; Frame, S. R.; Buxton, L. W.; Kennedy, G. L. Evaluation of chronic toxicity and carcinogenicity of ammonium 2,3,3,3-tetrafluoro-2-(heptafluoropropoxy)-propanoate in Sprague–Dawley rats. *Toxicol. Rep.* **2015**, *2*, 939–949.
- (19) Wang, J.; Wang, X.; Sheng, N.; Zhou, X.; Cui, R.; Zhang, H.; Dai, J. RNA-sequencing analysis reveals the hepatotoxic mechanism of perfluoroalkyl alternatives, HFPO2 and HFPO4, following exposure in mice. *J. Appl. Toxicol.* **2016**.
- (20) Gomis, M. I.; Wang, Z.; Scheringer, M.; Cousins, I. T. A modeling assessment of the physicochemical properties and environmental fate of emerging and novel per- and polyfluoroalkyl substances. *Sci. Total Environ.* **2015**, *505*, 981–991.
- (21) Rayne, S.; Forest, K. Perfluoroalkyl sulfonic and carboxylic acids: A critical review of physicochemical properties, levels and patterns in waters and wastewaters, and treatment methods. *J. Environ. Sci. Health, Part A: Toxic/Hazard. Subst. Environ. Eng.* **2009**, *44* (12), 1145–1199.
- (22) Quiñones, O.; Snyder, S. A. Occurrence of perfluoroalkyl carboxylates and sulfonates in drinking water utilities and related waters from the United States. *Environ. Sci. Technol.* **2009**, *43* (24), 9089–9095.
- (23) Shivakoti, B. R.; Fujii, S.; Nozoe, M.; Tanaka, S.; Kunacheva, C. Perfluorinated chemicals (PFCs) in water purification plants (WPPs) with advanced treatment processes. *Water Sci. Technol.: Water Supply* **2010**, *10* (1), 87–95.
- (24) Eschauzier, C.; Beerendonk, E.; Scholte-Veenendaal, P.; De Voogt, P. Impact of treatment processes on the removal of perfluoroalkyl acids from the drinking water production chain. *Environ. Sci. Technol.* **2012**, *46* (3), 1708–1715.
- (25) Rahman, M. F.; Peldszus, S.; Anderson, W. B. Behaviour and fate of perfluoroalkyl and polyfluoroalkyl substances (PFASs) in drinking water treatment: A review. *Water Res.* **2014**, *50*, 318–340.
- (26) Appleman, T. D.; Higgins, C. P.; Quiñones, O.; Vanderford, B. J.; Kolstad, C.; Zeigler-Holady, J. C.; Dickenson, E. R. V. Treatment of poly- and perfluoroalkyl substances in U.S. full-scale water treatment systems. *Water Res.* **2014**, *51*, 246–255.
- (27) Merino, N.; Qu, Y.; Deeb, R. A.; Hawley, E. L.; Hoffmann, M. R.; Mahendra, S. Degradation and removal methods for perfluoroalkyl and polyfluoroalkyl substances in water. *Environ. Eng. Sci.* **2016**, *33* (9), 615–649.
- (28) Appleman, T. D.; Dickenson, E. R. V.; Bellona, C.; Higgins, C. P. Nanofiltration and granular activated carbon treatment of perfluoroalkyl acids. *J. Hazard. Mater.* **2013**, *260*, 740–746.
- (29) Dudley, L. A.; Arevalo, E. C.; Knappe, D. R. U. *Removal of perfluoroalkyl substances by PAC adsorption and anion exchange*; Water Research Foundation: Denver, 2015.
- (30) Dunn, S. E.; Knappe, D. R. U. *Disinfection by-product precursor and micropollutant removal by powdered activated carbon*; Water Research Foundation: Denver, 2013.
- (31) Nakayama, S.; Strynar, M. J.; Helfant, L.; Egeghy, P.; Ye, X.; Lindstrom, A. B. Perfluorinated compounds in the Cape Fear drainage basin in North Carolina. *Environ. Sci. Technol.* **2007**, *41* (15), 5271–5276.
- (32) Unregulated contaminant monitoring rule 3 (UCMR 3). <http://water.epa.gov/lawsregs/rulesregs/sdwa/ucmr/ucmr3/>; U.S. Environmental Protection Agency: Washington, DC (accessed July 29, 2016).

Supporting information

Legacy and Emerging Perfluoroalkyl Substances Are Important Drinking Water Contaminants in the Cape Fear River Watershed of North Carolina

Supporting information includes analytical method description, 6 tables, and 5 figures.

Mei Sun^{1,2,*}, Elisa Arevalo², Mark Strynar³, Andrew Lindstrom³, Michael Richardson⁴, Ben Kearns⁴, Adam Pickett⁵, Chris Smith⁶, and Detlef R.U. Knappe²

¹Department of Civil and Environmental Engineering
University of North Carolina at Charlotte
Charlotte, North Carolina 28223, USA

²Department of Civil, Construction, and Environmental Engineering
North Carolina State University
Raleigh, North Carolina 27695, USA

³National Exposure Research Laboratory
U.S. Environmental Protection Agency
Research Triangle Park, North Carolina 27711, USA

⁴Cape Fear Public Utility Authority
Wilmington, North Carolina 28403, USA

⁵Town of Pittsboro
Pittsboro, North Carolina 27312, USA

⁶Fayetteville Public Works Commission
Fayetteville, North Carolina 28301, USA

*Corresponding Author Email: msun8@uncc.edu; Phone: 704-687-1723

Analytical standards: PFASs studied in this research are listed in Table S1. For legacy PFASs, native and isotopically labeled standards were purchased from Wellington Laboratories (Guelph, Ontario, Canada). Native PFPrOPrA was purchased from Thermo Fisher Scientific (Waltham, MA). No analytical standards were available for other PFECAs.

PFAS quantification: PFAS concentrations in samples from DWTPs and adsorption tests were determined by liquid chromatography tandem mass spectrometry (LC-MS/MS) using a large-volume (0.9 mL) direct injection method. An Agilent 1100 Series LC pump and PE Sciex API 3000 LC-MS/MS system equipped with a 4.6 mm x 50 mm HPLC column (Kinetex C18 5 μ m 100Å, Phenomenex Inc.) was used for PFAS analysis. The eluent gradient is shown in Table S4 in SI. All samples, calibration standards, and quality control samples were spiked with isotopically labeled internal standards, filtered through 0.45- μ m glass microfiber syringe filters, and analyzed in duplicate. The MS transitions for PFAS analytes and internal standards are shown in Table S5 in SI. The quantitation limit (QL) was 25 ng/L for PFOS and perfluorodecanoic acid, and 10 ng/L for other legacy PFASs and PFPrOPrA. The QL was defined as the first point of the standard curve, for which the regression equation yielded a calculated value within $\pm 30\%$ error. For PFECAs without analytical standards, chromatographic peak areas are reported.

PFAS concentrations along the treatment train of DWTP C were analyzed using a Waters Acquity ultra performance liquid chromatograph interfaced with a Waters Quattro Premier XE triple quadrupole mass spectrometer (Waters, Milford, MA, USA) after solid phase extraction. Method details are described elsewhere.¹ The QL for all PFASs with analytical standards was 0.2 ng/L, and peak areas were recorded for PFECAs without standards.

Table S1. Perfluoroalkyl substances (PFASs) detected in the Cape Fear River (CFR) watershed

Compound	Molecular weight	Formula	CAS #	# of perfluorinated carbons	Chain length (including all C, O and S)
Perfluorocarboxylic acids (PFCAs)					
Perfluorobutanoic acid (PFBA)	214.0	C ₄ HF ₇ O ₂	375-22-4	3	4
Perfluoropentanoic acid (PFPeA)	264.0	C ₅ HF ₉ O ₂	2706-90-3	4	5
Perfluorohexanoic acid (PFHxA)	314.1	C ₆ HF ₁₁ O ₂	307-24-4	5	6
Perfluoroheptanoic acid (PFHpA)	364.1	C ₇ HF ₁₃ O ₂	375-85-9	6	7
Perfluorooctanoic acid (PFOA)	414.1	C ₈ HF ₁₅ O ₂	335-67-1	7	8
Perfluorononanoic acid (PFNA)	464.1	C ₉ HF ₁₇ O ₂	375-95-1	8	9
Perfluorodecanoic acid (PFDA)	514.1	C ₁₀ HF ₁₉ O ₂	335-76-2	9	10
Perfluorosulfonic acids (PFSAs)					
Perfluorobutane sulfonic acid (PFBS)	300.1	C ₄ HF ₉ SO ₃	375-73-5	4	5
Perfluorohexane sulfonic acid (PFHxS)	400.1	C ₆ HF ₁₃ SO ₃	355-46-4	6	7
Perfluorooctane sulfonic acid (PFOS)	500.1	C ₈ HF ₁₇ SO ₃	1763-23-1	8	9
Perfluoroalkyl ether carboxylic acids with one ether group (mono-ether PFECAs)					
Perfluoro-2-methoxyacetic acid (PFMOAA)	180.0	C ₃ HF ₅ O ₃	674-13-5	2	4
Perfluoro-3-methoxypropanoic acid (PFMOPrA)	230.0	C ₄ HF ₇ O ₃	377-73-1	3	5
Perfluoro-4-methoxybutanoic acid (PFMOBA)	280.0	C ₅ HF ₉ O ₃	863090-89-5	4	6
Perfluoro-2-propoxypropanoic acid (PFPrOPrA)	330.1	C ₆ HF ₁₁ O ₃	13252-13-6	5	7
Perfluoroalkyl ether carboxylic acids with multiple ether group (multi-ether PFECAs)					
Perfluoro(3,5-dioxahexanoic) acid (PFO2HxA)	246.0	C ₄ HF ₇ O ₄	39492-88-1	3	6
Perfluoro(3,5,7-trioxaoctanoic) acid (PFO3OA)	312.0	C ₅ HF ₉ O ₅	39492-89-2	4	8
Perfluoro(3,5,7,9-tetraoxadecanoic) acid (PFO4DA)	378.1	C ₆ HF ₁₁ O ₆	39492-90-5	5	10

Table S2. Operational conditions of DWTP C on sampling day (August 18, 2014)

Parameter	Value
Raw water ozone dose	3.1 mg/L
Raw water total organic carbon concentration	6.0 mg/L
Aluminum sulfate coagulant dose	43 mg/L
Coagulation pH	5.70
Settled water ozone dose	1.3 mg/L
Settled water total organic carbon concentration	1.90 mg/L
Empty bed contact time in biological activated carbon filters	9.4 minutes for granular activated carbon layer 2.3 minutes for sand layer
Medium pressure UV dose	25 mJ/cm ²
Free chlorine dose	1.26 mg/L as Cl ₂
Free chlorine contact time	17.2 hours

Table S3. Water quality characteristics of surface water used in adsorption tests

Non-purgeable organic carbon (mg/L)	Ultraviolet absorbance at a wavelength of 254 nm	pH	Alkalinity (mg/L as CaCO ₃)	Conductivity (µS/cm)
9.036	0.399	7.53	19	133.5

Table S4. LC gradient method for PFAS analysis

Time (min)	Mobile Phase A% (v/v)	Mobile Phase B%	Flow Rate (mL/min)
0 – 2	95	5	0.9
2 – 5	95	5	0.9
5 – 10	95 → 10	5 → 90	0.9
10 – 10.1	10	90	0.9
10.1 – 14	10 → 95	90 → 5	0.9

Mobile phase A: 2 mM ammonium acetate in ultrapure water with 5% methanol

Mobile phase B: 2 mM ammonium acetate in acetonitrile with 5% ultrapure water

Table S5. MS transitions for PFAS Analysis

	Compound	MS/MS Transition	Internal standard
Legacy PFASs	PFBA	212.8 → 168.8	13C4-PFBA
	PFPeA	262.9 → 218.8	13C2- PFHxA
	PFHxA	313.6 → 268.8	13C2- PFHxA
	PFHpA	362.9 → 318.8	13C4- PFOA
	PFOA	413.0 → 368.8	13C4- PFOA
	PFNA	463.0 → 418.8	13C4- PFOA
	PFDA	513.1 → 68.8	13C2-PFDA
	PFBS	299.1 → 98.8	18O2-PFHxS
	PFHxS	399.1 → 98.8	18O2-PFHxS
	PFOS	498.9 → 98.8	13C4-PFOS
PFECAs	PFMOAA	180.0 → 85.0	N/A
	PFMOPrA	229.1 → 184.9	N/A
	PFMOBA	279.0 → 234.8	N/A
	PFPPrOPrA	329.0 → 284.7	13C2- PFHxA
	PFO2HxA	245.1 → 85.0	N/A
	PFO3OA	311. → 84.9	N/A
	PFO4DA	377.1 → 85.0	N/A
Internal standards	Perfluoro-n-[1,2,3,4- ¹³ C ₄]butanoic acid (13C4-PFBA)	217.0 → 172	Not applicable
	Perfluoro-n-[1,2- ¹³ C ₂]hexanoic acid (13C2-PFHxA)	315.1 → 269.8	
	Perfluoro-n-[1,2,3,4- ¹³ C ₂]octanoic acid (13C4-PFOA)	417.0 → 372.0	
	Perfluoro-n-[1,2- ¹³ C ₂]decanoic acid (13C2-PFDA)	515.1 → 469.8	
	Sodium perfluoro-1-hexane[¹⁸ O ₂]sulfonate (18O2-PFHxS)	403.1 → 83.8	
	Sodium perfluoro-1-[1,2,3,4- ¹³ C ₄]octane sulfonate (13C4-PFOS)	502.9 → 79.9	

Table S6. Maximum, minimum, mean and median concentrations (ng/L) of PFASs at three drinking water intakes. *

	Community A				Community B				Community C			
	max	min	median	mean	max	min	median	mean	max	min	median	mean
PFBA	99	<10	26	33	38	<10	12	12	104	<10	12	22
PFPeA	191	14	44	62	38	<10	19	19	116	<10	30	36
PFHxA	318	<10	48	78	42	<10	<10	11	24	<10	<10	<10
PFHpA	324	<10	39	67	85	<10	<10	11	24	<10	<10	<10
PFOA	137	<10	34	46	32	<10	<10	<10	17	<10	<10	<10
PFNA	38	<10	<10	<10	<10	<10	<10	<10	<10	<10	<10	<10
PFDA	35	<25	<25	<25	<25	<25	<25	<25	<25	<25	<25	<25
PFBS	80	<10	<10	<10	11	<10	<10	<10	<10	<10	<10	<10
PFHxS	193	<10	10	14	14	<10	<10	<10	14	<10	<10	<10
PFOS	346	<25	29	44	43	<25	<25	<25	40	<25	<25	<25
PFPrOPrA	<10	<10	<10	<10	10	<10	<10	<10	4560	55	304	631
PFOA+PFOS	447	0	64	90	59	0	0	9	55	<10	<10	<10
∑ PFASs**	1502	18	212	355	189	0	47	62	4696	55	345	710

* Concentrations less than quantitation limits were considered as zero to calculate means and ∑ PFASs.

** Other PFECAs were present in water samples from community C but could not be quantified and were therefore not included in ∑ PFASs

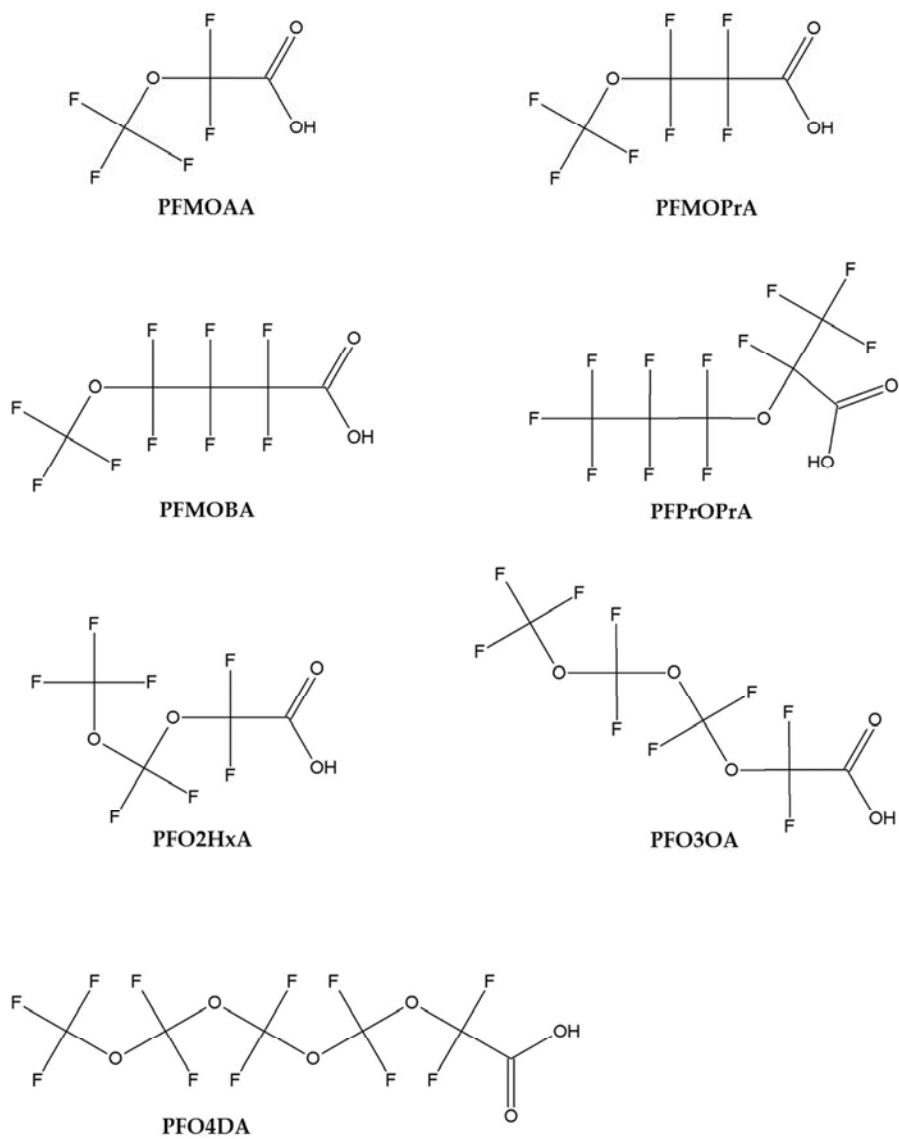


Figure S1. Molecular structures of PFECAs evaluated in this study

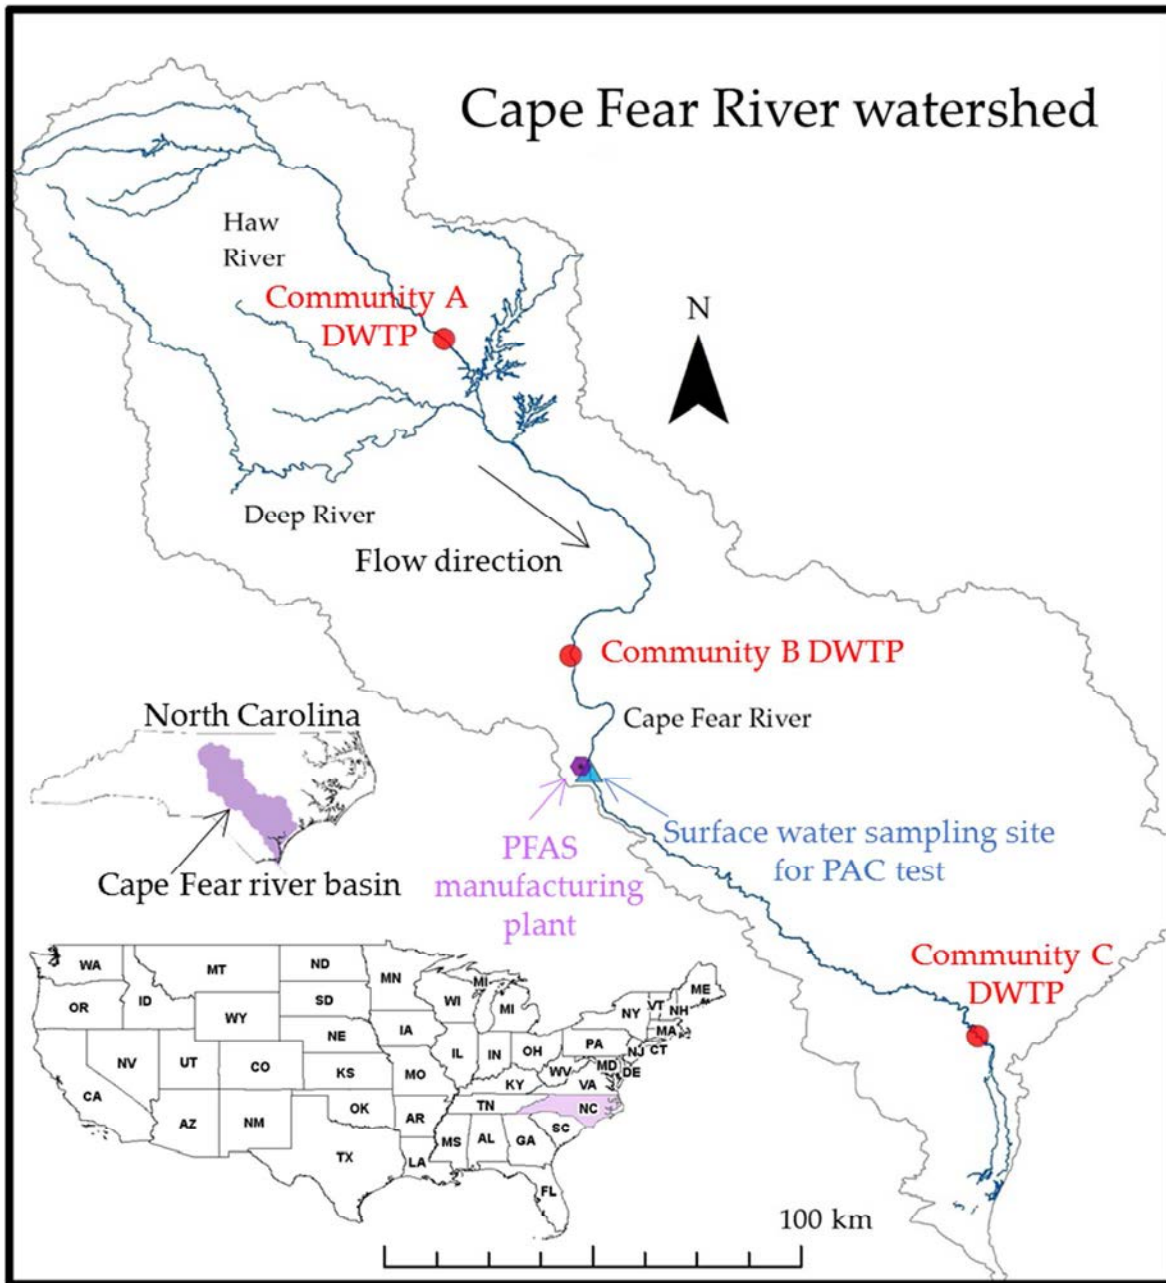
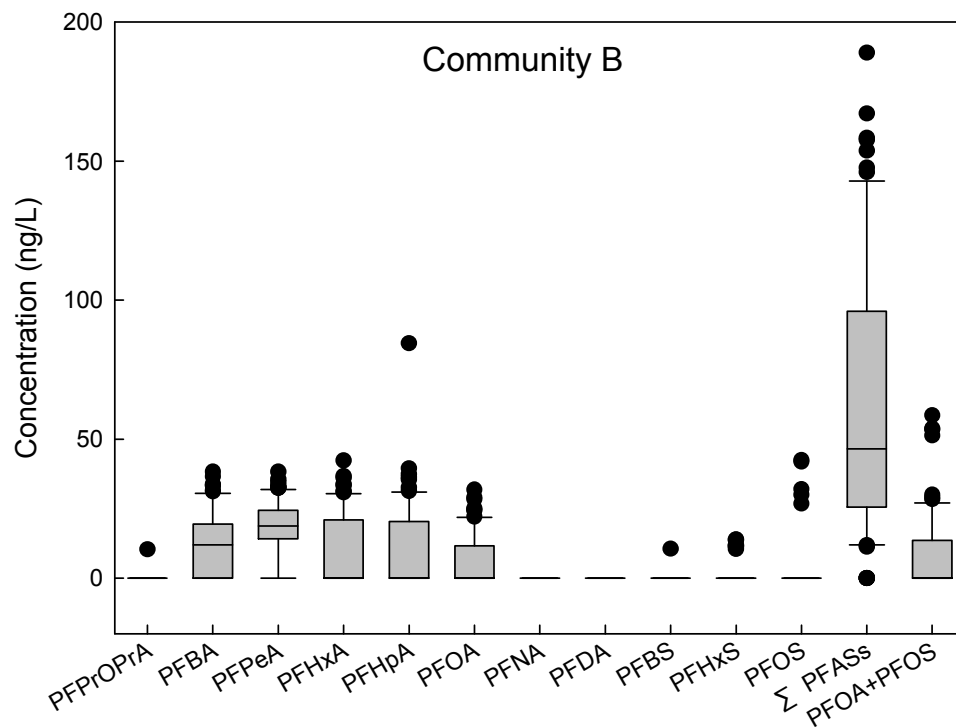
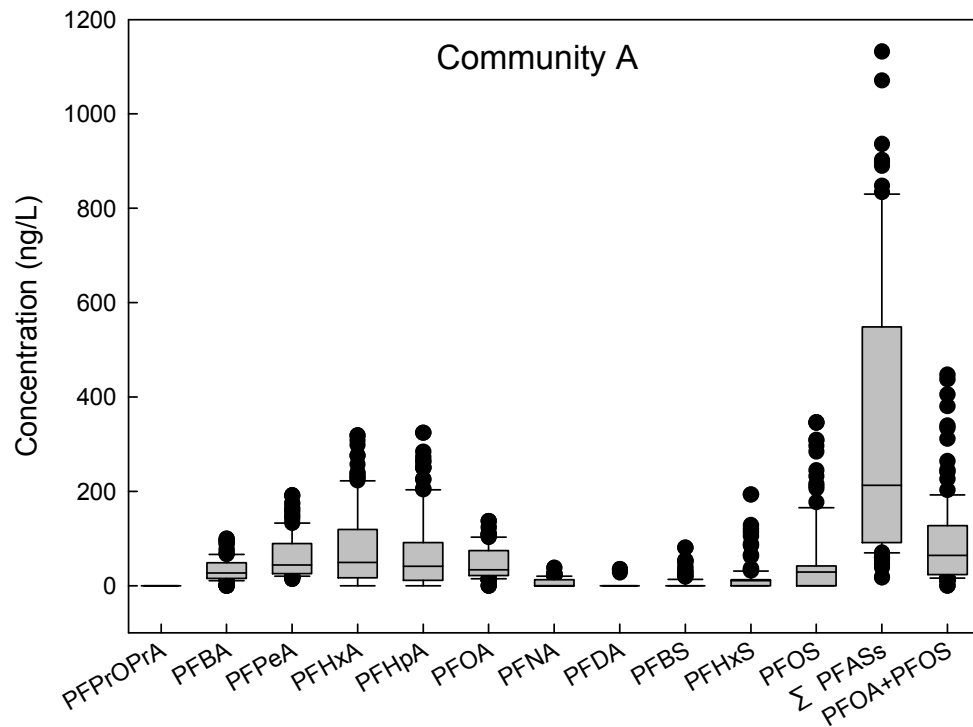


Figure S2. Sampling sites in the Cape Fear River watershed, North Carolina. The scale is for the Cape Fear River watershed map.



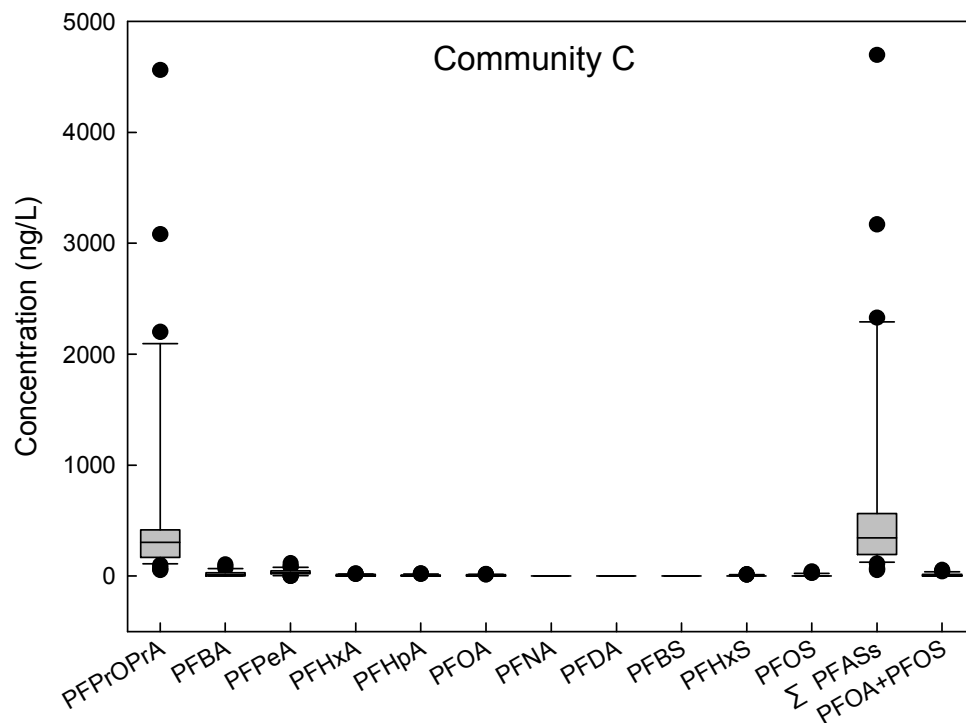


Figure S3. PFAS concentration distributions in the CFR watershed at three drinking water intakes. Concentrations less than quantitation limits were considered as zero. Upper and lower edges of a box represent the 75th and 25th percentile, respectively; the middle line represents the median; upper and lower bars represent the 90th and 10th percentile, respectively; and dots represent outliers (>90th or <10th percentile).

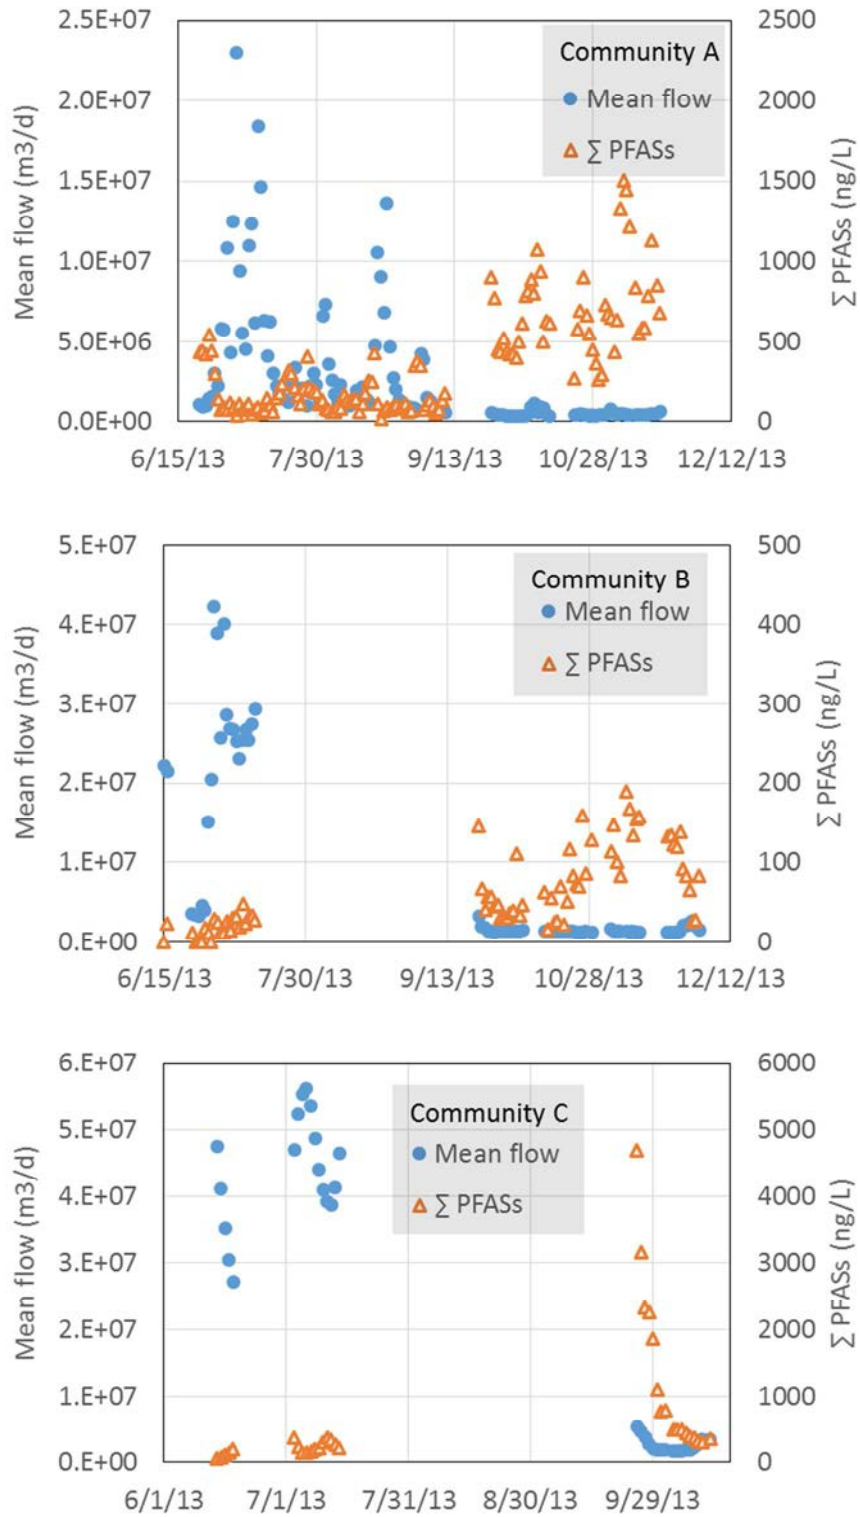


Figure S4. Total PFAS concentrations in the source water and stream flow at the three studied DWTPs. Stream flow data were acquired from US Geological Survey stream gage records

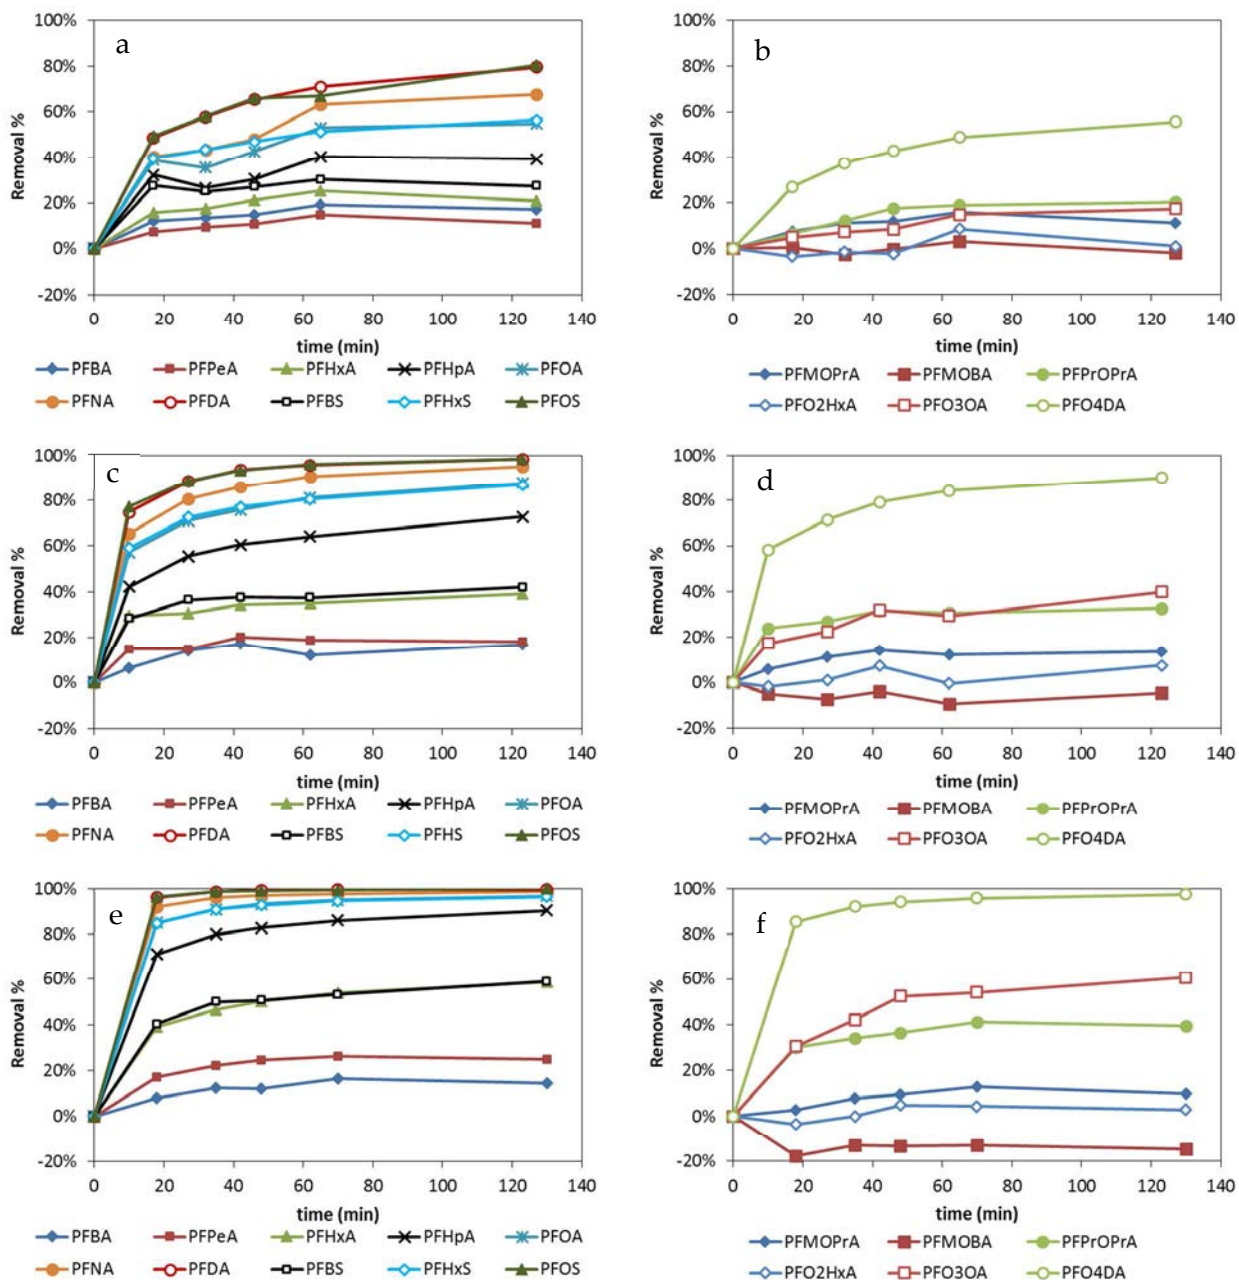


Figure S5. PFAS adsorption at powdered activated carbon doses of (a, b) 30 mg/L, (c, d) 60 mg/L and (e, f) 100 mg/L. Figures show average PFAS removal percentages of duplicate tests.

Reference

1. Nakayama, S.; Strynar, M. J.; Helfant, L.; Egeghy, P.; Ye, X.; Lindstrom, A. B., Perfluorinated compounds in the Cape Fear drainage basin in North Carolina. *Environ. Sci. Technol.* **2007**, *41*, (15), 5271-5276.